

PLANS AND SPECIFICATIONS FOR

BUCHANAN HIGH SCHOOL
COLD BOX REPLACEMENT
FOR
CLOVIS UNIFIED SCHOOL DISTRICT
1560 N. MINNEWAWA AVE.
CLOVIS, CA 93619



4910 E. Clinton Way, Suite 101
Fresno, CA 93727
(559) 431-0101

ELECTRICAL CONSULTANT

BORRELLI AND ASSOCIATES, INC.
John Borrelli, E16390
2032 N. Gateway Blvd.
Fresno, CA 93727
(559) 233-4138

STRUCTURAL CONSULTANT

PARRISH HANSEN
Robert Parrish, S2331
418 Clovis Ave.
Fresno, CA 93612
(559) 323-1023

JANUARY, 2023

PROJECT MANUAL FOR

BUCHANAN HIGH SCHOOL – COLD
BOX REPLACEMENT
CLOVIS UNIFIED SCHOOL DISTRICT


1560 N. MINNEWAWA AVE.
CLOVIS, CA 93619




MECHANICAL ENGINEER:

PREPARED BY:

LAWRENCE ENGINEERING GROUP
CONSULTING MECHANICAL ENGINEERS
4910 EAST CLINTON WAY, SUITE 101
FRESNO, CALIFORNIA 93727



ELECTRICAL ENGINEER:

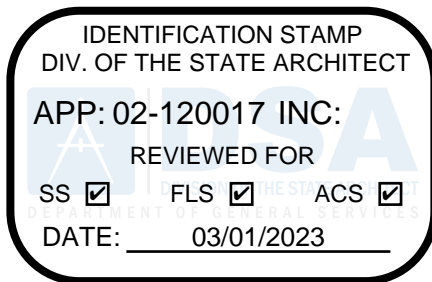

STRUCTURAL ENGINEER:

TECHNICAL SPECIFICATIONS – TABLE OF CONTENTS

DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)

23 00 00	GENERAL MECHANICAL PROVISIONS – SEE PLANS, SHEET M-4
23 00 01	HEATING, VENTILATING AND AIR CONDITIONING – SEE PLANS, SHEET M-4

DIVISION 26 - ELECTRICAL

26 00 00	GENERAL ELECTRICAL REQUIREMENTS
26 05 00	BASIC ELECTRICAL MATERIALS AND METHODS
26 05 26	GROUNDING AND BONDING
26 05 29	HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS
26 05 48	VIBRATION AND SEISMIC CONTROLS FOR ELECTRICAL SYSTEMS
26 08 00	COMMISSIONING OF ELECTRICAL SYSTEMS
26 27 00	LOW VOLTAGE (0-600V) DISTRIBUTION EQUIPMENT
26 28 00	LOW VOLTAGE (0-600V) CIRCUIT PROTECTIVE DEVICES

PART 1 – GENERAL

1.1 SECTION INCLUDES

This section includes general requirements specifically applicable to Division 26.

1.2 RELATED SECTIONS

- A All included sections under Division 26
- B Plans
- C Manufacturers' manuals, product bulletins, etc.

1.3 REFERENCE STANDARDS AND CODES

- A Standards
 - 1 AEIC – Association of Edison Illuminating Companies
 - 2 ANSI – American National Standards Institute
 - 3 ASTM – American Society of Testing and Materials
 - 4 CBM – Certified Ballast Manufacturers Association
 - 5 EIA – Electronic Industry Association
 - 6 ICEA – Insulated Cable Engineers Association
 - 7 IEEE – Institute of Electrical and Electronics Engineers
 - 8 NEMA – The Association of Electrical and Medical Imaging Equipment Manufacturers
 - 9 FM - Factory Mutual
 - 10 UL – Underwriter's Laboratory's, Inc., Standards for Safety
- B Local codes and authorities having jurisdiction
 - 1 City codes
 - 2 County codes
 - 3 Local fire department
- C State codes and authorities having jurisdiction
 - 1 CBC – California Building Code
 - 2 CEC – California Electrical Code
 - 3 State of California Codes
- D National codes and authorities having jurisdiction
 - 1 NESC – National Electrical Safety Code
 - 2 OSHA – Occupational Safety and Health Act
- E Utilities
 - 1 Local cable company
 - 2 Local electrical company
 - 3 Local telephone company
- F Code compliance
 - 1 All work and materials shall comply with the latest rules, codes and regulations, including, but not limited to the following:
 - a Occupational Safety and Health Act Standards (OSHA).
 - b CCR, Title 24, Part 3: California Electrical Code (CEC)
 - c All other applicable Federal, State and Local laws and regulations.
 - 2 Code compliance is mandatory. Nothing in these Drawings and Specifications permits work not conforming to National, State, and Local electrical and building codes. Where work is shown to exceed minimum code requirements, comply with Drawings and Specifications.
 - 3 No work shall be concealed until after inspection and approval by proper authorities. If work is concealed without inspection and approval, the Contractor shall be responsible for opening the concealed areas, making any required corrections and/or modifications to his work, and restoring the area to its previous condition.

1.4 DEFINITIONS (APPLICABLE TO DRAWINGS AND SPECIFICATIONS)

- A Provide: To supply, install and connect complete and ready for safe and regular operation of particular work referred to unless specifically otherwise noted.
- B Install: To erect, mount and connect complete with related accessories.
- C Supply: To purchase, procure, acquire and deliver complete with related accessories.
- D Work: Labor, materials, equipment, apparatus, controls, accessories and other items required for proper and complete installation.
- E Wiring: Raceway, fittings, wire, boxes, related items and connection.
- F Concealed: Embedded in masonry or other construction, installed in furred spaces, within double partitions or hung ceilings, in trenches, in crawl spaces or in enclosures.
- G Exposed: Either visible or subject to mechanical or weather damage, indoors or outdoors, including areas such as mechanical and storage rooms. In general, any item that is directly accessible without removing panels, walls, ceiling or other parts of structure.
- H Indicated, Shown, or Noted: As indicated, shown or noted on Drawings or Specifications.
- I Above Grade: Not buried in ground and not embedded in concrete slab on ground.
- J Below Grade: Buried in ground or embedded in concrete slab on ground.
- K Underground: Buried in ground, including under building slabs.
- L Connect: Complete hookup of item with required services, including conduit, wire and other accessories.
- M Furnish: Supply and deliver complete.
- N Similar or Equal: Of base bid manufacturer, equal in materials, weight, size, design, and efficiency of specified product, equivalent to Base Bid Manufacturer's product.
- O Reviewed, Satisfactory, Accepted, or Directed: As reviewed, satisfactory, accepted or directed by or to engineer.
- P Motor Controllers: Manual or magnetic starters (with or without switches), individual pushbuttons, or hand-off-automatic (HOA) switches controlling the operation of motors.
- Q Control Devices: Automatic sensing and switching devices such as thermostats, pressure, float, electro-pneumatic switches and electrodes controlling operation of equipment.
- R Contractor: Electrical Sub Contractor unless stated otherwise.
- S Use (verb): Furnish and install as defined above.

1.5 LICENSES, FEES AND PERMITS

Pay for all City, County or State electrical licenses, fees and permits. Arrange for all required inspections by agencies or authorities having local jurisdiction. The owner shall pay for all inspection fees and permits.

1.6 CONDITIONS AT SITE

- A A visit to the site is required of all bidders prior to submission of bid. All will be held to have familiarized themselves with all discernible conditions and no extra payment will be allowed for work required because of these conditions, whether specifically mentioned or not.
- B Underground or overhead lines or other services that are damaged as a result of this work shall promptly be repaired at no expense to the Owner and to complete satisfaction of the Owner.

1.7 DRAWINGS AND SPECIFICATIONS

- A All Drawings and all Divisions of these Specifications shall be considered as a whole and work of this Division shown anywhere therein shall be furnished under this Division.

- B The Contract Drawings are diagrammatic and indicate the general arrangement of equipment and wiring. Most direct routing of conduit and wiring is not assured. Exact requirements shall be governed by architectural, structural and mechanical conditions of the job. Consult all other Drawings in preparation of the bid. Extra lengths of wiring or addition of pull or junction boxes, etc., necessitated by such conditions shall be included in the bid. Check all information and report any apparent discrepancies before submitting bid.
- C Right is reserved to make change up to ten (10) feet in location of any outlet, device, or equipment prior to roughing in without increasing contract cost.
- D Equipment and fixtures shall be connected to provide circuit continuity in accordance with applicable codes, whether or not each piece of conductor, conduit or protective device is shown between items of equipment or fixtures and the point of circuit origin.

1.8 SAFETY AND INDEMNITY

- A Safety: The Contractor shall be solely and completely responsible for conditions of the job site, including safety of all persons and property during performance of the work. This requirement shall apply continuously and not be limited to normal working hours.
- B No act, service, Drawing review or construction review by Owner, the Architect, the Engineers or their Consultants, is intended to include review of the adequacy of the Contractor's safety measures, in on or near the construction site.

1.9 RECORD DRAWINGS

- A Submit record Drawings under provisions of Section 013000.
- B Submit prior to final acceptance inspection, one complete marked-up set of reproducible engineering design Drawings.
 - 1 Fully illustrate revisions made by crafts in course of work.
 - 2 Include field changes, adjustments, variances, substitutions and deletions, including Change Orders.
 - 3 Indicate exact location of raceways, equipment, and devices.
 - 4 Indicate exact size and location of underground and under floor raceways, grounding conductors, and duct banks.
 - 5 The record Drawings shall show all the work actually constructed and originally shown on the Drawing based upon the field construction by the Contractor.
- C These Drawings shall be for record purposes for Owner's use and are not considered Shop Drawings.

1.10 MANUFACTURER'S INSTRUCTIONS

- A Where the Specifications call for an installation to be made in accordance with manufacturer's recommendations, a copy of such recommendations shall at all times be kept in the job superintendent's office and shall be available to the Owner's representative.
- B Follow manufacturer's instructions where they cover points not specifically indicated on Drawings and Specifications. If they are in conflict with the Drawings and Specifications, obtain clarification from the Architect or Engineer before starting work.
- C One (1) set of equipment manufacturer's Drawings shall be submitted to the Engineer for their record.

1.11 OPERATING AND MAINTENANCE MANUALS

- A Operating and maintenance manuals and close-out documents are used interchangeably
- B Submit operating and maintenance manuals of equipment in the following format. Owner shall decide which format they prefer.
 - 1 Three (3) hardcopy sets

- 2 PDF format
- C For specific requirements, see the sections in which the equipment is specified.

1.12 QUALITY ASSURANCE

- A Provide a meaningful quality assurance program. To assist the Contractor in this program, the Specifications contained herein are set forth as the minimum acceptable requirements. This does not relieve the Contractor from executing other quality assurance measures to obtain a complete operating facility within the scope of this project.
- B The Contractor shall insure that workmanship, materials employed, required equipment and the manner and method of installation conforms to accepted construction and engineering practices, and that each piece of equipment is in satisfactory working condition to satisfactorily perform its functional operation.

1.13 GUARANTEE

Guarantee the installation free from defects of workmanship and materials for a period of one (1) year after Date of Certificate of final payment and promptly remedy any defects developing during this period, without charge.

1.14 BIDDING

- A The contractor shall bid on the plans, specifications, etc. that constitute the contract documents.
- B The contractor shall not attempt to modify the contract documents without the approval of the electrical engineer.
- C All "value engineering" proposals shall be submitted in to the electrical engineer writing.
- D If the contractor makes changes to the contract documents not approved by the electrical engineer, the contractor will still be responsible for installing all devices, conductors, conduits, etc. the contract documents call for.

1.15 ABBREVIATIONS

AIC	Amps interrupting capability
ANSI	American National Standards Institute
ASTM	ASTM International, formerly American Society for Testing and Materials
CAD	Computer aided design
CBC	California Building Code
CEC	California Electrical Code
CFR	Code of Federal Regulations
CMC	California Mechanical Code
CPC	California Plumbing Code
CSFM	California State Fire Marshal
DPDT	Double pole, double throw
DPST	Double pole, single throw
DSA	Division of the State Architect
EIA	Electronic Industries Association
EMT	Electrometallic conduit
EOR	Engineer of record
FMC	Flexible metallic conduit
GRS	Galvanized, rigid steel conduit
HMI	Human machine interface
ICC-ES	International Code Council Evaluation Service
IEEE	Institute of Electrical and Electronic Engineers
IGBT	Insulated Gate Bipolar Transistor

IMC	Intermediate metallic conduit
I/O	Input/output
IOR	Inspector of record
ISO	International Organization for Standardization
LCD	Liquid crystal display
LED	Light emitting diodes
NEC	National Electrical Code
NEMA	Association of Electrical Equipment and Medical Imaging Manufacturers
NETA	National Electrical Testing Association
NFPA	National Fire Protection Association
NICET	National Institute for Certification in Engineering Technologies
NIST	National Institute of Standards and Technology
OCPD	Overcurrent protection device
PDF	Portable document format
PG&E	Pacific Gas and Electric
PID	Proportional, integral, derivative control
PLC	Programmable logic controller
PQM	Power quality monitor
PVC	Polyvinyl chloride
SCCR	Short circuit current rating
SPD	Surge protective device
SPDT	Single pole, double throw
SPST	Single pole, single throw
TFT	Thin film transistor
THD	Total harmonic distortion
TIA	Telecommunications Industries Association
UL	Underwriters' Laboratories
USB	Universal series bus
UPS	Uninterruptable power supply
VFD	Variable frequency drive
VFD	Vacuum fluorescent display

PART 2 – PRODUCTS

2.1 MATERIAL APPROVAL

- A All materials must be new and bear Underwriters' Laboratories label. Materials that are not covered by UL testing standards shall be tested and approved by an independent testing laboratory or a governmental agency.
- B Material not in accordance with these Specifications may be rejected either before or after installation.
- C Materials or equipment specified by:
 - 1 Name of manufacturer.
 - 2 Brand or trade name.
 - 3 Catalog reference.

2.2 SUBSTITUTIONS

- A Base the bid on use of materials specified.
- B Equipment other than specified will be considered for approval provided it meets previous items A through C and the following is submitted in writing by the Contractor to the Engineer to allow approval at least 14 days before the bid date:
 - 1 The request for permission to substitute shall be accompanied with a statement of the amount of money to be returned to the contract if the substitution is permitted.

- 2 Return a completed request for substitution form.
- C The engineer is the sole judge of acceptability of preferred substitutions.
- D If a substitute is permitted, and any re design effort is thereby necessitated, the required re design shall be at the Contractor's expense.

2.3 SUBMITTALS

Submit to architect, or engineer if no architect is involved, seven (7) copies of complete Shop Drawings and materials lists, as noted below, for review within thirty (35) days after award of contract. All proposed deviations from Specifications must be clearly listed and submitted separately under a prominent heading entitled "Substitutions."

- A Fire Alarm Systems
- B Communication Systems
- C Pull Boxes and Cabinets
- D Conduit and Wire
- E Service and distribution
- F Transformers

2.4 OPERATING AND MAINTENANCE MANUALS

Submit Operating and Maintenance Manuals of equipment as specified under Division 1. Verify exact quantity with architect, or engineer if no architect is involved.

2.5 PRODUCT DELIVERY, STORAGE AND HANDLING

- A Equipment shall be shipped in its original packages, to prevent damaging or entrance of foreign matter. Handling and shipping shall be performed in accordance with manufacturer's recommendations. Provide protective covering during construction.
- B Replace at no expense to Owner, equipment or material damaged during the storage or handling, as directed by the engineer.
- C Equipment shall be tagged with a weatherproof tag identifying equipment by name and purchase order number. Packing and shipping lists shall be included.

PART 3 – EXECUTION

3.1 CLEARANCE

Minimum code required clearances for electrical equipment shall not be violated.

3.2 WORKMANSHIP AND CONTRACTOR'S QUALIFICATIONS

- A Only quality workmanship will be accepted. Haphazard or poor installation practice will be cause for rejection of work.
- B The Electrical Contractor shall provide a Superintendent in charge of this work at all times to direct the quality of the installation.

3.3 COORDINATION

- A Coordinate work with other trades to avoid conflict and to provide correct rough in and connection for equipment furnished under other trades and requiring electrical

- connections. Inform Contractors of other trades of the required access to and clearances around electrical equipment to maintain serviceability and code compliance.
- B Verify equipment dimensions and requirements with provisions specified under this Section. Check actual job conditions before fabricating work. Report necessary changes in time to prevent needless work. Changes or additions subject to additional compensation and agreed price shall be at Contractor's risk and expense.
 - C Provide temporary feeds and connections to areas and equipment as required to allow phased construction and operation.

3.4 CUTTING AND PATCHING

All cutting and patching required for work of this Division is included herein. Coordination with General Contractor and other trades is imperative. Contractor shall bear the responsibility for and bear the added expense of adjusting for improper holes, supports, etc.

END OF SECTION

REQUEST FOR SUBSTITUTION

To: _____

A. _____ submits for your consideration the following product instead of the specified item:

1. Project: _____
2. Section or Sheet: _____, Article or Paragraph: _____
3. Specified Item: _____
4. Proposed Substitution (Mfg., Type, Model, etc.): _____

B. Complete all of the following:

1. Does this substitution off the Owner a cost credit (including costs for changes by other trades)? _____ How much? _____
2. Does this substitution offer earlier delivery or less construction time? _____ How much? _____ How so? _____
3. How does the substitution affect any dimensions, layout, or details of other trades as shown on the Drawings? _____

4. What are the specific differences between this substitution and the specified item?

C. Attach the following items.

1. Manufacturer's technical data _____
2. Laboratory test or performance results _____
3. Drawings and wiring diagrams of the proposed product _____
4. Drawings and description of changes required by other trades _____
5. Manufacturer's guarantee and maintenance instructions _____

D. The undersigned agrees to pay for all additional review, design, testing, changes in contract documents, and construction as a result of the acceptance of this substitution, at no cost to the Owner.

E. Submitted by (Firm) _____

Print name _____

Signature _____ Date _____

Accepted Rejected Revise and Resubmit See Attached

END OF REQUEST FOR SUBSTITUTION

PART 1 – GENERAL

1.1 SECTION INCLUDES

Materials, equipment fabrication, installation and tests in conformity with applicable codes and authorities having jurisdiction, for the following:

- A Conduit and raceways
- B Wire and cables
- C Outlet boxes
- D Junction boxes
- E Pull boxes
- F Grounding

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A All included sections under Division 26
- B Plans
- C Manufacturers' manuals, product bulletins, etc.

1.3 REFERENCE STANDARDS AND CODES

Published specification standards, tests or recommended methods of trade, industry or government organizations apply to work in this section as cited in Section 260000.

- A American Society for Testing and Materials
 - 1 ASTM B3: Standard Specification for Soft or Annealed Copper Wire
 - 2 ASTM B33: Standard Specification for Tin-Coated or Annealed Copper Wire for Electrical Purposes
 - 3 ASTM B738: Standard Specification for Fine-Wire Bunch-Stranded and Rope-Lay Bunch-Stranded Copper Conductors for Use as Electrical Conductors
 - 4 ASTM B355: Standard Specification for Nickel-Coated, Soft or Annealed Copper Wire
 - 5 ASTM D412: Standard Test Methods for Vulcanized Rubber and Thermoplastic Elastomers—Tension
- B California Electrical Code (CEC)
- C Institute of Electrical and Electronic Engineers (IEEE)
 - 1 IEEE 81: Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System Part 1: Normal Measurements
 - 2 IEEE 82: Standard Test Procedure for Impulse Voltage Tests on Insulated Conductors
 - 3 IEEE 95: Standard Test Procedure for Impulse Voltage Tests on Insulated Conductors
 - 4 IEEE 141: Recommended Practice for Electric Power Distribution for Industrial Plants
 - 5 IEEE 142: IEEE Recommended Practice for Grounding of Industrial and Commercial Power Systems
 - 6 IEEE 241: Recommended Practice for Electric Power Systems in Commercial Buildings
 - 7 IEEE 242: Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems (IEEE Buff Book)
 - 8 IEEE 399: Recommended Practice for Industrial and Commercial Power Systems Analysis (Brown Book)
 - 9 IEEE 442: Guide for Soil Thermal Resistivity Measurements
 - 10 IEEE 576: Recommended Practice for Installation, Termination, and Testing of Insulated Power Cable as Used in Industrial and Commercial Applications
 - 11 IEEE 1185: Recommended Practice for Cable Installation in Generating Stations and Industrial Facilities

- D Underwriters' Laboratories
- 1 UL 1: Flexible Metal Conduits
 - 2 UL 5: Surface Metal Raceways and Fittings
 - 3 UL 5B: Standard for Strut-Type Channel Raceways and Fittings
 - 4 UL 5C: Standard for Surface Raceways and Fittings for Use with Data, Signal, and Control Circuits
 - 5 UL 6: Electrical Rigid Metal Conduit – Steel
 - 6 UL 13: Power Limited Circuit Cables
 - 7 UL 83: Thermoplastic Insulated Wires and Cables
 - 8 UL 310: Electrical Quick-connect Terminals
 - 9 UL 360: Liquid Tight Flexible Steel Conduit
 - 10 UL 444: Communications Cables
 - 11 UL 467: Grounding and Bonding Equipment
 - 12 UL 486A: Wire Connectors
 - 13 UL 486B: Wire Connectors
 - 14 UL 486C: Splicing Wire Connectors
 - 15 UL 486D: Sealed Wire Connector Systems
 - 16 UL 486E: Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors
 - 17 UL 493: Thermoplastic Insulated Underground Feeder and Branch Circuit Cables
 - 18 UL 510: Polyvinyl Chloride, Polyethylene, and Rubber Insulating Tape
 - 19 UL 514A: Metallic Outlet Boxes
 - 20 UL 514B: Conduit, Tubing, and Cable Fittings
 - 21 UL 514C: Nonmetallic Outlet Boxes, Flush-device Boxes, and Covers
 - 22 UL 514D: Cover Plates for Flush-mounted Wiring Devices
 - 23 UL 635: Insulating Bushings
 - 24 UL 651: Schedule 40, 80, Type EB and A Rigid PVC Conduit and Fittings
 - 25 UL 797: Electrical Metallic Tubing – Steel
 - 26 UL 870: Wireways, Auxiliary Gutters, and Associated Fittings
 - 27 UL 969: Marking and Labeling Systems
 - 28 UL 1242: Standard for Electrical Intermediate Metal Conduit - Steel
 - 29 UL 1332: Organic Coatings for Steel Enclosures for Outdoor Use Electrical Equipment
 - 30 UL 1446: Systems of Insulating Materials – General
 - 31 UL 1479: Fire Tests of Through Penetration Firestops
 - 32 UL 1565: Position Devices (includes cable ties and clamps)
 - 33 UL 1581: Reference Standard for Electrical Wires, Cables, and Flexible Cords
 - 34 UL 1652: Flexible Metallic Tubing
 - 35 UL 1685: Vertical-tray Fire Propagation and Smoke Release Test for Electrical and Optical Fiber Cables
 - 36 UL 1773: Standard for Termination Boxes
 - 37 UL 1977: Component Connectors for Use in Data, Signal, Control, and Power Applications
 - 38 UL 2024: Standard for Signaling, Optical Fiber and Communications Raceways and Cable Routing Assemblies
 - 39 UL 2196: Test for Fire Resistive Cables
 - 40 UL 2238: Standard for Cable Assemblies and Fittings for Industrial Control and Signal Distribution
 - 41 UL 2239: Hardware for the Support of Conduit, Tubing, and Cable
 - 42 UL 2256: Nonmetallic Sheathed Cable Interconnects
 - 43 UL 2277: Flexible Motor Supply Cable and Wind Turbine Tray Cable
 - 44 UL 2459: Insulated Multi-pole Splicing Wire Connectors
 - 45 UL 2556: Wire and Cable Test Methods

1.4 QUALITY ASSURANCE

- A Equipment and accessories shall be the product of a manufacturer regularly engaged in its manufacture.
- B Supply equipment and accessories new, free from defects.
- C Equipment and accessories in compliance with the applicable standards listed in Article 1.3 of this section and with applicable national, state and local codes.
- D Items of a given type shall be the products of the same manufacturer.
- E Deliver, store and protect products under provisions of Section 016000.
- F Ship equipment in its original packages, to prevent damaging or entrance of foreign matter. Perform handling and shipping in accordance with manufacturer's recommendations. Provide protective covering during construction.
- G Replace at no expense to Owner, equipment or material damaged during storage or handling, as directed by the engineer.
- H Tag items with a weatherproof tag identifying equipment by name and purchase order number. Include packing and shipping lists.

1.5 SUBMITTALS

- A Submit under provisions of Section 013000 or 013300.
- B Submittals shall include the following:
 - 1 Table of contents
 - 2 A complete set of detailed manufacturer's specifications describing and illustrating all standard and special components and materials
 - 3 Part numbers
 - 4 Evidence of compliance with the applicable standards listed under Article 1.3 of this section
 - 5 Maintenance instructions and intervals
 - 6 Calibration procedures and intervals
 - 7 A complete set of drawings for any special items
 - 8 Wiring diagrams
- C Electronic submittals shall be searchable
- D Seismic Restraint and Anchorage: Provide complete seismic anchorage and bracing for the lateral and vertical support of conduit and electrical equipment in accordance with CBC, Title 24, Part 2, Section 1616A.1 and ASCE 7-10 Section 13.6, and all provisions of this Section.
 - 1 Submit calculations prepared and signed by a Structural Engineer licensed in the State of California, showing compliance with the above for all electrical equipment weighing more than 50 pounds, excepting items corresponding exactly in configuration and weight to those specified and detailed. Where anchorage details are not shown on drawings, the field installation shall be subject to the approval of the Electrical Engineer.
 - 2 All equipment mounted on concrete shall be secured with post-installed concrete requiring a drilled hole. Power driven anchors are not acceptable. Minimum spacing shall be 10 diameter center-to-center and 5 diameters center to edge of concrete. Maximum allowable loads for tension and shear shall be as determined in compliance with ACI 318-14 Chapter 17 and the anchor's ICC or IAPMO evaluation report. Acceptable manufacturers are Hilti, Red Head, and Simpson Strong Tie.
 - 3 Conduit and suspended equipment shall be provided with supports and seismic restraints in accordance with Unistrut, Inc. Seismic Bracing Guide, or Super Strut Inc., Seismic Restraint System guide. Support requirements shall be based upon similar equipment; i.e., water piping as equivalent to conduit with wire fill. A copy of the guide shall be on the job site during construction.
- E The submittal shall be substantially complete for all items and equipment furnished under this section.

- F Individual drawings and data sheets submitted at random intervals will not be accepted for review.
- G Substitutions: Items of same function and performance shall be submitted in conformance with Division 1.

1.6 OPERATION AND MAINTENANCE MANUALS

- A Submit operation and maintenance manuals in accordance with Section 260000.
- B The manuals shall, at minimum, include the following:
 - 1 Table of contents
 - 2 Manufacturer (including contact information)
 - 3 Model number
 - 4 Voltage ratings
 - 5 Current ratings
 - 6 List of capabilities
 - 7 Environmental ratings
 - 8 NEMA enclosure type
 - 9 Maintenance instructions and intervals
 - 10 Calibration procedures and intervals
 - 11 Installation instructions
 - 12 Repair instructions (where applicable)
 - 13 As-built drawings
- C Provide manuals in one of the following formats
 - 1 Three hardcopies
 - 2 PDF

PART 2 – PRODUCTS

2.1 CONDUIT AND OTHER RACEWAYS

- A Rigid Conduit, also referred to as Galvanized Rigid Steel Conduit (GRS)
 - 1 Material: High strength steel
 - 2 Coating
 - a All uses: hot-dipped galvanized
 - b Underground or corrosive areas
 - 1 40-mil, UV stabilized PVC coated
 - 2 Coating shall conform to NEMA RN-1
 - 3 Fittings shall be threaded.
 - 4 Conduit shall be UL-6 listed.
- B Intermediate Metal Conduit (IMC)
 - 1 Material: Steel
 - 2 Coating
 - a All uses: hot-dipped galvanized
 - b Underground or corrosive areas
 - 1 40-mil, UV stabilized PVC coated
 - 2 Coating shall conform to NEMA RN-1
 - 3 Conduit shall be UL-1242 listed.
- C Electrical Metallic Tubing (EMT)
 - 1 Material: Steel
 - 2 Coating
 - a All uses: hot-dipped galvanized
 - b Underground or corrosive areas
 - 1 40-mil, UV stabilized PVC coated
 - 2 Coating shall conform to NEMA RN-1

- 3 Fittings shall be threaded.
- 4 Connectors and couplings
 - a Water tight, steel compression type exterior and in wet locations. Use ETP Fittings InspectoRidge or approved equal when possible.
 - b Steel set screw type in interior, dry locations.
- D Non-metallic conduit
 - 1 Conduit shall be schedule 40 PVC (minimum)
 - 2 Approved for use as non-metallic raceway with 90°C conductors
 - 3 Comply with NEMA TC-2 and NEMA TC-3
- E Flexible Metallic Conduit
 - 1 Material: High strength, hot-dipped galvanized steel
 - 2 Construction: Interlocked
 - 3 Conduits in damp, wet, or corrosive areas shall be liquid tight type with PVC jacket extruded over the steel conduit.
- F Fittings and accessories
 - 1 Fittings and accessories for all conduit types shall be approved for the purpose and equal in all respects to the conduit or raceway.
 - 2 Fittings and accessories for metallic conduits shall be made of ferrous metal and galvanized after fabrication.
- G Pull lines
 - 1 Pull line shall be 1/8 inch diameter, yellow color.
 - 2 Pull lines shall be Tubbs Cordage "Polyline" or approved equal.
- H Wireways
 - 1 NEMA type
 - a NEMA-1 for dry locations
 - b NEMA-3R or NEMA-4 for damp and wet locations
 - c NEMA-4X for corrosive locations
 - 2 Metal type
 - a Non-corrosive locations: mild steel
 - b Corrosive locations: stainless steel
 - 3 Thicknesses
 - a 6"x6" cross-section and smaller: 16 gauge
 - b 8"x8" cross-section and larger: 14 gauge
 - 4 Finish: The entire enclosure shall be finished as follows:
 - a Degreasing
 - b Cleaning
 - c Phosphatizing
 - d Electrostatic deposition of polymer polyester powder coating followed by baking to produce a hard, durable finish.
 - 1 The average thickness of the paint film shall be 2.0 mils.
 - 2 Paint film shall be uniform in color and free from blisters, sags, flaking and peeling
 - e Finish shall conform to UL 50 and UL 50E.
 - f Color shall match surrounding area.
 - 5 Covers
 - a Wireways shall have hinged covers.
 - b NEMA 3R, 4 and 4X wireways shall be a gasket on the inside of the cover to seal the wireway when cover is closed.
 - c Covers shall have latches to secure the cover in the closed position.
 - 6 Wireways shall be UL listed.
- I Raceways shall be UL listed.

2.2 WIRE AND CABLE

- A Conductors for power and lighting systems 600V or less:

- 1 Conductors shall be 90°C rated.
- 2 Conductors size #12 AWG and larger shall be stranded copper.
- 3 Type:
 - a THWN for wet or underground locations
 - b THHN for dry locations.
 - c 90°C rated
- 4 Minimum conductor size for voltage drop:
 - a Minimum size #12 AWG for runs 50 feet or less for 208/120V systems or 100 feet or less for 480/277V systems
 - b Increase conductor by one size by one method below:
 - 1 For each additional 50 feet for 208/120V systems or 100 feet for 480/277V systems.
 - 2 Calculate voltage drop and size as directed by CEC Voltage Drop Restrictions.
 - c Underground circuits shall be #8 AWG minimum wire, unless otherwise noted.
 - d Once the contractor has determined conductors' route, calculate the minimum size to meet maximum voltage drop allowed per CEC using $D_{min}=C*L*I/(V_D*N)$.
 - 1 D_{min} is the minimum diameter (circular mills)
 - 2 $C=24$ for copper, $C=39$ for aluminum
 - 3 L is conductor length (feet)
 - 4 I is the current (amps)
 - 5 V_D is the maximum allowable voltage drop (volts)
 - 6 N is the quantity of parallel conductors per phase
- 5 Minimum size conductors for OCPD shall be determined from CEC Table 310.16 with ampacity corrected for 115°F.
- 6 Conductor size shall be the largest size to meet maximum voltage drop (2.2 A 4) and to meet CEC ampacity requirements (2.2 A 5).
- B For Signal and Communication Circuits:
 - 1 Special Cables: As specified on Drawings.
 - 2 Conductors for general communications use: Stranded copper conductor, #16 AWG minimum, with THWN insulation for underground or wet locations and THHN insulation for dry locations.
 - 3 Ends of stranded conductors shall be tinned.

2.3 OUTLET BOXES, JUNCTION BOXES, AND PULL BOXES

- A Above ground locations
 - 1 Outlet Boxes
 - a Hot-dipped galvanized after fabrication
 - b Of required size, minimum 4 inches square, for flush mounted devices and lighting fixtures
 - c Cast type with gasketed covers for outdoor or wet locations.
 - d Device and fixture back boxes shall be 2-1/4" deep, minimum.
 - 2 Junction and Pull Boxes
 - a Use outlet boxes with appropriate covers as junction boxes wherever possible.
 - b Larger junction and pull boxes
 - 1 Sheet steel, hot dipped galvanized after fabrication, finished gray baked enamel
 - 2 Sized according to code
 - 3 Screw-on covers.
- B In-ground pull boxes, handholes, and manholes
 - 1 Precast concrete type with required extension collars.

- 2 Covers
 - a Lids shall be steel or reinforced concrete, as shown on plans. Pull box lids in traffic areas or large grassy areas subject to mowing by riding mowers shall traffic rated.
 - b Covers shall include hold down bolts.
 - c Top of cover shall be flush with top of box.
 - d Covers shall be identified as ELECTRICAL, SIGNAL, or COMMUNICATIONS unless otherwise specified.
 - 3 Size boxes as indicated on Drawings. If size is not indicated on Drawings, use CEC as a minimum requirement.
 - 4 Boxes shall have 2" thick (minimum), reinforced concrete bottoms with 1" diameter drain hole over 12" of crushed rock.
 - 5 Boxes shall have approved cable supports.
 - 6 Concrete encased stubs for handholes extending five (5) feet beyond handhole.
 - 7 All pull boxes shall be no smaller than a Christy N-9.
 - 8 All pull boxes shall be set flush to finished grade and shall have an 8-inch wide by 3-inch thick concrete mow strip poured around it.
 - 9 Manufacturer shall be Brooks Products, Oldcastle Enclosure Solutions (Christy), Jensen Precast, or approved equal.
 - 10 All sections between box, extension rings, etc. and penetrations shall be sealed with mortar.
- C Floor Boxes
- 1 Provide Walker or equal Modulink non-metallic floor box for concrete areas.
 - 2 Provide quantity of boxes required to accommodate each device.
 - 3 Provide Walker Wood Floor Boxes at wood floors provide quantity required to accommodate each device.
 - 4 Provide brass flip cover lids.
- D Outlet boxes, junction boxes, pull boxes, etc. recessed in a concrete wall shall be deep masonry boxes.

2.4 CONDUIT AND EQUIPMENT SUPPORTS

- A Conduit supports
- 1 For individual conduit runs not directly fastened to the structure: Rod hangers
 - 2 For multiple conduit runs: Trapeze type conduit support designed for maximum loading deflection not exceeding manufacturer's recommendations.
- B Materials
- 1 All materials not otherwise noted:
 - a Steel with the finished part hot dipped galvanized
 - b Stainless steel for corrosive or damp environments
 - 2 All bolts and nuts shall be stainless steel.
- C Supports anchored to earth shall be anchored in a concrete base per details.
- D Manufacturers shall be Caddy, Unistrut, Powerstrut, or approved equal.
- E All exposed channels shall have end caps made by the channel manufacturer and designed for use with the channel.

2.5 WIRE CONNECTORS

- A For wire size #8 AWG and smaller: Insulated, screw type, rated 105°C, 600V for building wiring and 1000V for fixtures; Scotchlok, Ideal, or approved equal.
- B For wire size #6 AWG and larger: T&B or approved equal screw type with 3M "#33+" or Plymouth "Slipknot Gray" tape insulation.
- C Underground wire splices
- 1 Connect ends of conductors with copper compression connectors, 3M Scotchlok or approved equal.

- 2 Seal splice with inline resin splice kit approved for weather exposure, direct burial, and wet locations, 3M Scotchcast or approved equal.
- D Only set screw, compression type connectors may be used for MC cables. Fish hook/open tang connectors are prohibited.

2.6 GROUNDING

- A Ground Rods
 - 1 3/4 inch diameter
 - 2 Copper weld type
 - 3 10 feet in length.
- B Ground Wire: Conductors shall be medium-hard drawn, copper, and stranded, with sizes as shown on drawings.
- C Utilize CADWELD Multi-System Exothermic Welding for below grade ground connections.
- D Bolts, nuts, and washers shall be bronze, cadmium plated steel, or other corrosion resistant material approved for the purpose.

2.7 MISCELLANEOUS MATERIALS

- A All screws, bolts, nuts, and washers on equipment outdoors or in wet or corrosive environments shall be stainless steel.

2.8 SEALANTS

- A General purpose sealant: One-part polysulfide or polyurethane, Federal Standard TT-S-00230c or two-part polyurethane, Federal Standard TT-SS-227E of Mameco Vulkem 116 or 227 or approved equal product manufactured by Products Research and Chemical Corporation. Pecora, Sika, Sonneborn, or Tremco may be substituted under provisions of Section 016000.
- B Conduit sealant
 - 1 Two-part, self-curing urethane
 - 2 Non-sagging
 - 3 Liquid and gas tight
 - 4 Chemically stable once cured
 - 5 Compatible with conduit and conductor materials
 - 6 Designed for use as conduit seal
- C Fire retardant sealant: Dow Corning Company, Type 3-6548 silicone RTV foam sealant, closed cell, 18 lb. density, 2-part system with UL certification. Type 96-081 one-part sealant shall be used for small spaces and cracks. 3M Fire Barrier Caulk CP25 is also acceptable.

2.9 IDENTIFICATION

- A Nameplates:
 - 1 White, acrylic plastic suitable for indoor or outdoor use
 - 2 Face colored as below with engraved, white, 3/16" minimum, Arial or similar font characters
 - a Equipment on normal systems: Black face
 - b Equipment on emergency systems: Red face
 - 3 Clear plastic overlay suitable for indoor or outdoor use that can be replaced if vandalized.
 - 4 Sign shall include device name, voltage, and size.
 - 5 Outdoor nameplates shall be UV stable and fade resistant.
- B Pull line identification tags:

- 1 Aluminum plate
- 2 1/8" tall (minimum), Arial (or similar) font, identifying text stamped on plate
- 3 Tags shall describe conduit's length, source, and destination.

PART 3 – EXECUTION

3.1 GENERAL

- A Electric system layouts indicated on the Drawings are generally diagrammatic but shall be followed as closely as actual construction and work of other trades will permit. Govern exact routing of cable and wiring and the locations of outlets by the structure and equipment served. Dimensions shall be taken from Architectural Drawings.
- B Consult all other Drawings. Verify scales and report any dimensional discrepancies or other conflicts to architect, or engineer if no architect is involved, before submitting bid.
- C Home runs to panelboards are indicated as starting from the outlet nearest the panel and continuing in the general direction of that panel. Continue such circuits to the panel as though the routes were completely indicated. Terminate homeruns of signal, alarm, and communications system in a similar manner.
- D Avoid cutting and boring holes through structure or structural members wherever possible. Obtain prior approval of Architect and conform to structural requirements when cutting or boring the structure is necessary or permitted.
- E Furnish and install necessary hardware, hangers, blocking, brackets, bracing, runners, required for equipment specified under this section.
- F Provide necessary backing required to insure rigid mounting of outlet boxes.
- G Install pull line in all conduits to remain that will have their conductors removed.

3.2 INSTALLATION OF CONDUIT

- A Run conduit concealed unless otherwise noted or shown on Drawings.
- B Run exposed conduit parallel to or at right angles to center lines of columns and beams.
- C Run no conduit in concrete slabs or floors except at point of penetration. Penetrations shall be at right angles to slab surfaces.
- D Install conduit above ceilings to avoid obstructing removal of ceiling tiles, lighting fixtures, air diffusers, etc.
- E Conduit shall not cross any duct shaft or area designated as future duct shaft. Coordinated with mechanical work to avoid any conflict.
- F Install pull line in empty conduit installed under this contract. Provide and install labels as describe in "Identification" sub-section.
- G Spare conduits shall be capped to prevent intrusion of moisture and foreign objects.
- H Minimum conduit size shall be 1/2 inches when installed above ground and 3/4 inches when installed underground or under building slabs. Increase conduit size as required for wiring. Size for conduit, unless specifically shown otherwise, shall be determined from Table 3 for all conductors, Chapter 9 of latest National Electric Code.
- I Conduit shall be galvanized rigid conduit:
- J Use flexible steel conduit in the following applications:
 - 1 Recessed lighting fixtures.
 - 2 Motor connections.
 - 3 Connection between fan plenum and structure.
 - 4 At expansion joints.
 - 5 At transformers and other equipment which produce vibration.
- K Provide junction boxes/pull boxes as required to limit any power system conduit run to a maximum of four (4) 90 degree bends (two (2) 90 degree bends for signal communication system conduit runs) or to avoid "U" bends.
- L Conduit Supports:

- 1 Support conduit with Underwriters' Laboratories listed conduit support intervals required by the California Electric Code.
 - 2 Wire or sheet metal strips are not acceptable for conduit not directly fastened to structure or for multiple conduit runs.
 - 3 Individual conduit 1/2 inch and 3/4 inch size may be supported from ceiling support wire with Caddy clips only if acceptable to local code. Only one conduit is permitted to be attached to any ceiling support wire. Hang such conduit so as not to affect level of ceiling.
 - 4 Avoid attaching conduit to fan plenums. When it is necessary to support conduit from fan plenum, provide a length of flexible conduit between the section attached to the fan plenum and other sections. Provide a length of flexible conduit between the portion attached to the building to minimize transmission of vibration to the building structure.
- M Conduit penetration of roof, walls, floors and ceilings shall be sealed to preserve the integrity of waterproofing, fire rating and soundproofing for which the roof, wall, floor or ceiling is designed. Materials and methods used shall conform to that specified under Architectural sections.
- N Where flush branch circuit panelboards or terminal cabinets are shown on walls, stub a minimum of four (4) 1 inch empty conduit into overhead ceiling spaces and four (4) 1 inch empty conduit into space below floor (if any) in addition to conduit required for circuit wiring.
- O Paint all exposed conduit to match its surroundings.
- P Where rigid steel conduit runs in direct contact with the earth, conduit shall be wrapped with 10-mil PVC tape to form 40 mil of protection or shall have factory applied PVC coating.
- Q Label all conduits at each terminus, pull box, and junction box.
- R All conduits shall have a minimum of one pull line.
- S All pull lines shall be tagged at both ends so as to indicate the length of the conduit run, source, and the destination.

3.3 INSTALLATION OF WIRE

- A Install all wiring in raceway unless specifically shown or noted otherwise.
- B Pull no wire into any portion of the conduit system until construction work which may damage the wire has been completed.
- C Install wire continuous from outlet to outlet or terminal to terminal. Splices in cables when required shall be made in handholes, pull boxes or junction boxes. Make branch circuit splices in outlet boxes with 8 inches of correctly color-coded tails left in the box.
- D Make splices in wires and cables utilizing specified materials and methods.
- E Cables and wires passing through handholes shall be full looped inside the handhole (360 degree) and supported on galvanized steel racks, beginning 10" above the bottom of the handhole. Leave handhole in clean condition with debris removed.
- F Make ground, neutral, and line connections to receptacle and wiring device terminals as recommended by manufacturer. Provide ground jumper from outlet box to ground terminal of devices when the device is not approved for grounding through the mounting screws.
- G Provide Brady wire markers where number of conductors in a box exceed four (4).
- H Wiring shall be tested for continuity (600V and below). All systems shall be entirely free from grounds, short circuits, and any or all defects.
- I Measure and record the insulation resistance of 600 volt insulated conductors size #4/0 AWG and larger using a 500 volt megger for one minute. Make tests with circuits isolated from source and load.
- J All conductor bends must have a radius greater than or equal to the manufacturer's listed bending radius.
- K Label all conductors at each terminus, pull box, and junction box.

3.4 WIRE COLOR CODE

- A Color code conductors. Wire sized #8 AWG and smaller shall have integral color-coded insulation. Wire sizes #6 AWG and larger may have black insulation but shall be identified by color coded electrical tape at junction, splice, pull and termination points. Apply color tape with 1/2 lap to at least 6 inches of the conductor.
- B Color code wire as follows:
- | | | |
|------------|----------|--|
| Conductors | 208/120V | 480/277V |
| Phase A | Black | Brown |
| Phase B | Red | Orange |
| Phase C | Blue | Yellow |
| Neutral | White | White or Gray (consistent throughout facility) |
| Ground | Green | Green |

3.5 CONNECTIONS TO EQUIPMENT

- A General:
- 1 Furnish and install required power supply conduit and wiring to equipment. See below for other wiring required.
 - 2 Furnish and install a disconnect switch immediately ahead of and adjacent to each magnetic motor starter or appliance unless the motor or appliance is located adjacent to and within sight of the serving panelboard, circuit breaker or switch. Verify equipment nameplate current ratings prior to installation.
 - 3 Mount motor starters including those furnished under other sections or specifications and provide power wiring to them.
 - 4 Install rough-in work for equipment from approved shop drawings to suit the specific requirements of the equipment.
 - 5 Furnish and install magnetic motor starters that are shown on the Drawings or specified under other divisions to be furnished under this division of work. Verify equipment nameplate ratings prior to installation and furnish adequately rated starters for the loads.
 - 6 Furnish and install manual thermal protection for motors not integrally equipped with thermal protection.
 - 7 Furnish and install 120V power to each control panel and time switch requiring a source of power to operate.
- B Heating, ventilating, and air conditioning equipment:
- 1 Coordinate with mechanical contractor for sizes, locations and details of motors, heating units, and control requirements.
 - 2 Provide required power supply conduit and wiring to equipment.
 - 3 Provide a suitable means of disconnect switch immediately ahead of and adjacent to each motor and appliance unless the motor or appliance is located adjacent and within sight of the service panelboard, circuit breaker or switch at a distance allowed by codes. Verify equipment nameplate current ratings prior to installation. Provide a disconnect means at each magnetic motor starter.
 - 4 Provide magnetic motor starters required under this division of work.
 - 5 Provide manual thermal protection for motors not integrally equipped with thermal protection.
 - 6 Line and low voltage temperature control and interlock wiring, conduit, and required connections are a part of other divisions unless specifically shown or noted on the Drawings as to be furnished under this section.
 - 7 Provide 120V power supply to control panels, time switch furnished and installed under other divisions of work.

- 8 Furnish and install 120V power to each duct detector scheduled for operation of fire dampers or shut down of mechanical equipment. Coordinate the exact quantity and locations with the mechanical drawings.
- C Plumbing and other contractor-furnished and Owner-furnished equipment:
 - 1 Required power and control conduit, wiring and connections are included under this section of the work. Control sensing and alarm devices will be furnished under the respective section of the contract supplying the equipment unless noted otherwise. These devices will be located in pipes, ducts, vessels, tanks, etc., and will be mounted in a place by the Contractor furnishing the devices. Other devices shall be mounted under this section of the work.
 - 2 Control panels for packaged equipment will be furnished under the respective section of the contract supplying the equipment unless otherwise noted. Installation and connection of the control panels are under this section of the work.

3.6 SYSTEM NEUTRAL GROUND

- A Ground the neutral conductor of each transformer to limit the maximum potential above ground due to normal operating voltage and limit the voltage level due to abnormal conditions.
- B Ground transformers with secondary voltage 600V class or less as follows: 3 phase, 4 wire wye connected: ground neutral point.
- C For transformers 75kVA size or lower with primary voltage 480V or lower, the primary equipment ground conductor may be used for grounding the secondary neutral provided it is adequately sized in accordance with CEC system ground conductor size.

3.7 EQUIPMENT GROUND

- A Ground non-current carrying metal parts of electrical equipment enclosures, frames, or conductor raceways to provide a low impedance path for line to ground fault current and to bond all non-current carrying metal parts together. Install a ground conductor in each raceway system. Equipment ground conductor shall be electrically and mechanically continuous from the electrical circuit source to the equipment to be grounded. Size ground conductors per CEC 250.95 unless otherwise shown on drawings.
- B Grounding conductors shall be identified with green insulation. Where green insulation is not available, on larger sizes, black insulation shall be used and suitably identified with green tape at each junction box or enclosure device.
- C Install metal raceway couplings, fittings and terminations secure and tight to insure good ground continuity. Provide grounding bushing and bonding jumper where metal raceway is not directly attached to equipment metal enclosure and at concentric knockouts.
- D Lighting fixtures shall be securely connected to equipment ground conductors. Outdoor lighting standards shall have a factory installed ground for terminating the ground wire.
- E Motors shall be connected to equipment ground conductors with a conduit grounding bushing and with a bolted solderless lug connection on the metal frame.

3.8 STRUCTURAL GROUND

- A Concrete encased electrode shall be 2 inches above the bottom of concrete footing where shown on drawings. See drawings for details.
- B Domestic, chilled and hot water mains and fire protection metallic water pipes shall be connected to the ground bus with #4/0 AWG bare copper conductor at a minimum of two points.
- C Miscellaneous metal objects including piping, vessels and structural shapes within six feet of metallic objects connected to the ground system and which are not interconnected

mechanically with the grounding system, shall be interconnected with a minimum #6 AWG bare copper conductor.

3.9 IDENTIFICATION

- A Provide and install nameplates on all switchboards, distribution boards, panels, motor starters, VFDs, transformers, safety switches/disconnects, push buttons, selector switches, pilot lights, and other similar devices. Fasten nameplates to equipment with one sheet metal screw at each corner.
- B Provide and install labels on lighting switches and convenience and special purpose receptacles to show panel and circuit number to which the device is connected.
- C Provide and install identification tags on all conduit pull.
- D Provide label meeting ANSI Z535 standards on motors reading:

WARNING

**AUTOMATIC EQUIPMENT
MAY START AT ANY TIME**

END OF SECTION

PART 1 – GENERAL

1.1 SECTION INCLUDES

Materials, equipment fabrication, installation and tests in conformity with equipment applicable to this project, applicable codes and authorities having jurisdiction, for grounding

1.2 RELATED SECTIONS

- A All included sections under Division 26
- B Plans
- C Manufacturers' manuals, product bulletins, etc.

1.3 REFERENCE STANDARDS

Published specifications standards, tests or recommended methods of trade, industry or government organizations apply to work in this section as cited in Section 16000.

1.4 QUALITY ASSURANCE

- A Equipment and accessories shall be the product of a manufacturer regularly engaged in its manufacture.
- B Supply equipment and accessories new, free from defects.
- C Supply equipment and accessories in compliance with the applicable standards listed in Article 1.3 of this section and with applicable national, state and local codes.
- D Items of a given type shall be the products of the same manufacturer.

1.5 SUBMITTALS

- A Submit under provisions of Section 01330. Provide detailed description of items supplied, including specifications, performance characteristics, materials, wiring diagrams and schedules.
 - 1 Submit evidence that products satisfy seismic requirements for the State of California.
 - 2 Submit evidence of compliance with the applicable standards listed under Article 1.3 of this section.
- B Manufacturer's Instructions: Submit manufacturer's installation instructions.
- C Product Data: Submit manufacturer's descriptive literature.
- D Shop Drawings: Submit complete fabrication details, elevations and sections of switchboard, dimensions, space available for conduit, rating, short circuit withstand ability of bus and lowest rated device, circuit schedule showing circuit number, device description, device frame ampere rating and trip, fuse clip ampere rating, termination lug size, feeder and circuit identification, conductor ratings and one-line and wiring diagrams. Include both elementary diagram and terminal to terminal wiring diagrams.
- E Substitutions: Items of same function and performance shall be in conformance with Division 1.
- F Submit field test and operations check report for circuit breakers and motor starters under provisions of Section 16080.

1.6 OPERATION AND MAINTENANCE DATA

- A Submit operation instructions, maintenance and repair data under provisions of Division 1.
- B Ship equipment in its original packages to prevent damaging or entrance of foreign matter. Perform handling and shipping in accordance with manufacturer's recommendations. Provide protective covering during construction.

- C Replace at no expense to Owner, equipment or material damaged during storage or handling, as directed by the engineer.
- D Tag items with a weatherproof tag identifying equipment by name and purchase order number. Include packing and shipping lists.

PART 2 – PRODUCTS

2.1 GROUND RODS

Ground rods shall be:

- A. 3/4 inch diameter
- B. Copper weld type
- C. 10 feet in length.
- D. Ground rings

2.2 BARE COPPER GROUND WIRE

Conductors shall be medium-hard drawn, copper, and stranded, with sizes as shown on drawings.

2.3 BELOW GRADE GROUND CONNECTIONS

Utilize CADWELD Multi-System Exothermic Welding.

2.4 HARDWARE

Bolts, nuts and washers shall be bronze, cadmium plated steel, or other non-corrosive material, approved for the purpose.

PART 3 – EXECUTION

3.1 SYSTEM NEUTRAL GROUND

- A Ground the neutral conductor of each transformer to limit the maximum potential above ground due to normal operating voltage and limit the voltage level due to abnormal conditions.
- B Ground transformers with secondary voltage 600V class or less as follows: 3-phase, 4-wire wye connected: ground neutral point.
- C For transformers 75kVA size or lower with primary voltage 480V or lower, the primary equipment ground conductor may be used for grounding the secondary neutral provided it is adequately sized in accordance with CEC system ground conductor size.

3.2 EQUIPMENT GROUND

- A Ground non-current carrying metal parts of electrical equipment enclosures, frames, or conductor raceways, structural metal supports for the mechanical and plumbing equipment to provide a low impedance path for line-to-ground fault current and to bond all non-current carrying metal parts together. Install a ground conductor in each raceway system. Equipment ground conductor shall be electrically and mechanically continuous from the electrical circuit source to the equipment to be grounded. Size ground conductors per CEC 250-95 unless otherwise shown on drawings.
- B Grounding conductors shall be identified with green insulation. Where green insulation is not available, on larger sizes, black insulation shall be used and suitably identified with green tape at each junction box or enclosure device.

- C Install metal raceway couplings, fittings and terminations secure and tight to insure good ground continuity. Provide grounding bushing and bonding jumper where metal raceway is not directly attached to equipment metal enclosure and at concentric knockouts.
- D Lighting fixtures shall be securely connected to equipment ground conductors. Outdoor lighting standards shall have a factory installed ground for terminating the ground wire.
- E Motors shall be connected to equipment ground conductors with a conduit grounding bushing and with a bolted solderless lug connection on the metal frame.

3.3 STRUCTURAL GROUND

- A Concrete encased electrode shall be 2 inches above the bottom of concrete footing where shown on drawings. See drawings for details.
- B Domestic, chilled and hot water mains and fire protection metallic water pipes shall be connected to the ground bus with #3/0 AWG bare copper conductor at a minimum of two points.
- C Miscellaneous metal objects including piping, vessels and structural shapes within six feet of metallic objects connected to the ground system and which are not interconnected mechanically with the grounding system, shall be interconnected with a minimum #3/0 AWG bare copper conductor.

3.4 GROUND RESISTANCE TEST

- A Building ground electrode resistance testing shall be accomplished with a ground resistance, direct reading, single test meter utilizing the Fall-of-Potential method and two (2) referenced electrodes. Perform test prior to interconnection to other grounding system. Orient the concrete encased ground electrode to be tested and the two referenced electrodes in straight line spaces fifty (50) feet apart. Drive the two (2) reference electrodes ten (10) feet deep.
- B Test results shall be in writing, and shall show temperature, humidity and condition of the soil at the time of the tests. In the case where the ground resistance exceeds 25 ohms, add an additional ground rod and retest. Add additional ground rods when necessary in order to bring the ground resistance below 25 Ohms. All testing shall be done prior to concrete pour and in the presence of the inspector of record. Provide test results for engineer review.

END OF SECTION

PART 1 – GENERAL

1.1 SECTION INCLUDES

- A. Hangers and supports for electrical equipment and systems.
- B. Construction requirements for concrete bases.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A All included sections under Division 26
- B Plans
- C Manufacturers' manuals, product bulletins, etc.

1.3 REFERENCE STANDARDS AND CODES

- A Published specifications standards, tests or recommended methods of trade, industry or government organizations apply to work in this section as cited in Section 260000.
- B American Society for Testing and Materials (ASTM)
 - 1 ASTM A36/A36M: Standard Specification for Carbon Structural Steel
 - 2 ASTM A276: Standard Specification for Stainless Steel Bars and Shapes
 - 3 ASTM B221: Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes
 - 4 ASTM F594: Standard Specification for Stainless Steel Nuts
- C California Building Safety Codes (CBSC)
 - 1 California Building Code (CBC)
 - 2 California Electrical Code (CEC)
- D General Services Administration
 - 1 W-C-582: Conduit, Raceway, Metal and Fittings: Surface
 - 2 ANSI/MSS SP-58: Pipe Hangers And Supports – Materials, Design, Manufacture, Selection, Application, And Installation
- E ICC Evaluation Service (ICC-ES)
 - 1 ESR-4266
- F Manufacturers Standardization Society (MSS)
 - 1 MSS SP-58: Pipe Hangers and Supports – Materials, Design, Manufacture, Selection, Application, and Installation
 - 2 MSS SP-69: Pipe Hangers and Supports – Selection and Application
- G Metal Framing Manufacturers' Association
 - 1 MFMA-4: Metal Framing Standard Publication
 - 2 MFMA-101: Guidelines for the Use of Metal Framing
- H National Electrical Contractors Association
 - 1 NECA 1: Standard Practice of Good Workmanship in Electrical Construction
 - 2 NECA 101: Standard for Installing Steel Conduits (RMC, IMC, EMT)
- I Underwriters' Laboratories
 - 1 UL 2239: Hardware for the Support of Conduit, Tubing, and Cable

1.4 QUALITY ASSURANCE

- A. Comply with latest editions of the California Building Code and California Electric Code

1.5 SUBMITTALS

- A. Submittals shall include the following:
 - 1. Table of contents
 - 2. A complete set of detailed manufacturer's specifications describing and illustrating all standard and special components and materials
 - 3. Part numbers

4. Evidence of compliance with the applicable standards listed under Article 1.3 of this section
5. Maintenance instructions and intervals
6. A complete set of drawings for any special items
- B. Electronic submittals shall be searchable
- C. Shop drawings shall be stamped and signed by a licensed structural engineer. Show fabrication and installation details and include calculations for the following:
 1. Trapeze hangers: include product data for components
 2. Steel slotted channel systems: include product data for components
 3. Equipment supports
- D. Welding certificates
- E. The submittal shall be substantially complete for all items and equipment furnished under this section.
- F. Individual drawings and data sheets submitted at random intervals will not be accepted for review.
- G. Substitutions: Items of same function and performance shall be submitted in conformance with Division 1.

1.6 OPERATION AND MAINTENANCE MANUALS

- A. Submit manuals at close out.
- B. The manuals shall, at minimum, include the following:
 1. Manufacturer (including contact information)
 2. Model number
 3. Load ratings
 4. Material type(s)
 5. Environmental ratings
 6. Maintenance requirements
 7. Installation instructions
 8. Repair instructions (where applicable)
- C. Provide manuals in one of the following formats
 1. Three hardcopies
 2. PDF

1.7 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Design supports for multiple raceways, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.
- B. Design supports for multiple raceways capable of supporting combined weight of supported systems and its contents.
- C. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.
- D. Rated Strength: Adequate in tension, shear, and pullout force to resist maximum loads calculated or imposed for this Project, with a minimum structural safety factor of five times the applied force.

PART 2 – PRODUCTS

2.1 SUPPORT, ANCHORAGE, AND ATTACHMENT COMPONENTS

- A. Steel Slotted Support Systems
 1. Comply with MFMA-4, factory-fabricated components for field assembly.
 2. Metallic Coatings: Hot-dip galvanized after fabrication and applied according to MFMA-4.

3. Nonmetallic Coatings:
 - a. PVC, polyurethane, or polyester coating applied according to MFMA-4.
 - b. Minimum thickness shall be 40 mils.
4. Painted Coatings: Manufacturer's standard painted coating applied according to MFMA-4.
5. Channel Dimensions: Selected for applicable load criteria.
6. Manufacturers:
 - a. Cooper B-Line, Inc.
 - b. ERICO International Corporation
 - c. Hilti Corporation
 - d. Thomas & Betts Corporation
 - e. Unistrut
 - f. Approved equal
- B. Raceway and Cable Supports: As described in NECA 1 and NECA 101.
- C. Conduit and Cable Support Devices: Steel hangers, clamps, and associated fittings, designed for types and sizes of raceway or cable to be supported.
- D. Support for Conductors in Vertical Conduit: Factory-fabricated assembly consisting of threaded body and insulating wedging plug or plugs for non-armored electrical conductors or cables in riser conduits. Plugs shall have number, size, and shape of conductor gripping pieces as required to suit individual conductors or cables supported. Body shall be malleable iron.
- E. Structural Steel for Fabricated Supports and Restraints: ASTM A36/A36M, steel plates, shapes, and bars; black and galvanized.
- F. Mounting, Anchoring, and Attachment Components:
 1. General:
 - a. Anchors shall be steel with corrosion resistant, durable coating or stainless steel
 - b. Select anchors with strength required for anchor and as tested according to ASTM E488.
 - c. Minimum length shall be eight times diameter.
 - d. Tension, shear, and pullout capacities shall be appropriate for supported loads and building materials used
 - e. Post installed anchors must be listed in a current evaluation report issued by one of the following:
 1. International Code Council Evaluation Service (ICC-ES)
(<http://www.icc-es.org/reports/index.cfm?search=search>)
 2. City of Los Angeles Research Report
 2. Powder-Actuated Fasteners:
 - a. Threaded-steel stud, for use in hardened portland cement concrete, steel, or wood
 - b. Manufacturers:
 1. Hilti Corporation
 2. Simpson Strong-Tie Co., Inc.
 3. Approved equal
 3. Mechanical-Expansion Anchors:
 - a. Insert-wedge-type, stainless steel, for use in hardened portland cement
 - b. Anchors shall meet the descriptive part of A-A-1923A Type 2.
 - c. Anchors shall be equivalent to Hilti Kwik-Bolt TZ2.
 4. Concrete inserts shall be steel or malleable-iron, slotted support system units similar to MSS Type 18; complying with MFMA-4 or MSS SP-58
 5. Clamps for attachment to steel structural elements: MSS SP-58, type suitable for attached structural element
 6. Toggle Bolts: All-steel springhead type
 7. Hanger Rods: Threaded steel

2.2 FABRICATED METAL EQUIPMENT SUPPORT ASSEMBLIES

- A. Description: Welded or bolted, structural-steel shapes, shop or field fabricated to fit dimensions of supported equipment.
- B. Materials:
 - 1. Comply with requirements with ASTM A36 (ferrous metals), ASTM A167 and ASTM A276 (stainless steel), and ASTM B221 and B632 (aluminum) for shapes and plates.
 - 2. Hot dipped galvanized steel
 - 3. Stainless steel for corrosive areas

PART 3 – EXECUTION

3.1 APPLICATION

- A. Comply with NECA 1 and NECA 101 for application of hangers and supports for electrical equipment and systems except if requirements in this Section are stricter.
- B. Maximum Support Spacing and Minimum Hanger Rod Size for Raceway: Space supports for EMT, IMC, and RMC as required by California Electrical Code. Minimum rod size shall be 1/4 inch (6 mm) in diameter.
- C. Multiple Raceways or Cables:
 - 1. Install trapeze-type supports fabricated with steel slotted support system, sized so capacity can be increased by at least 25 percent in future without exceeding specified design load limits.
 - 2. Secure raceways and cables to these supports with two-bolt conduit clamps
- D. Spring-steel clamps designed for supporting single conduits without bolts may be used for 1-1/2-inch (38-mm) and smaller raceways serving branch circuits and communication systems above suspended ceilings and for fastening raceways to trapeze supports.

3.2 SUPPORT INSTALLATION

- A. Comply with NECA 1 and NECA 101 for installation requirements except as specified in this Article.
- B. Raceway Support Methods: In addition to methods described in NECA 1, EMT, IMC, and RMC may be supported by openings through structure members, as permitted in California Electric Code.
- C. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum static design load used for strength determination shall be weight of supported components plus 200 lb (890 N).
- D. Mounting and Anchorage of Surface-Mounted Equipment and Components: Anchor and fasten electrical items and their supports to building structural elements by the following methods unless otherwise indicated by code.
 - 1. Wood framing: Fasten with lag screws or through bolts.
 - 2. Light gauge steel framing: self tapping screws
 - 3. Steel beams: beam clamps
 - 4. Concrete: expansion fasteners

3.3 CONDUIT SUPPORTS

- A. Conduit supports
 - 1. For individual conduit runs not directly fastened to the structure: Rod hangers
 - 2. For multiple conduit runs: Trapeze type conduit support designed for maximum loading deflection not exceeding manufacturer's recommendations.

- 3 Wire or sheet metal strips are not acceptable for conduit not directly fastened to structure or for multiple conduit runs.
- B Support conduit with Underwriters' Laboratories listed conduit support intervals required by the California Electric Code.
- C Individual conduit 1/2 inch and 3/4 inch size may be supported from ceiling support wire with Caddy clips only if acceptable to local code. Only one conduit is permitted to be attached to any ceiling support wire. Hang such conduit so as not to affect level of ceiling.
- D Avoid attaching conduit to fan plenums. When it is necessary to support conduit from fan plenum, provide a length of flexible conduit between the section attached to the fan plenum and other sections. Provide a length of flexible conduit between the portion attached to the building and the rest of the conduit run to minimize transmission of vibration to the building structure.
- E Supports anchored to earth shall be anchored in a concrete base per details.

3.4 INSTALLATION OF POST-INSTALLED ANCHORS

- A. Minimum distances
 - 1. Bolt hole edge to edge of concrete: 10 times bolt diameter
 - 2. Bolt center to bolt center: 12 times bolt diameter
- B. Expansion type anchors
 - 1. Anchor shall be installed and torque per manufacturer's recommendations.
 - 2. Setting verification:
 - a. Torque-controlled anchors: Following attainment of 10% of the required torque, torque-controlled anchors shall not require more than six (6) additional complete turns of the nut during installation to achieve the manufacturer's specified installation torque. The extent of bolt projection after installation shall be measured to confirm that this requirement has been met.
 - b. Displacement-controlled anchors: The position of the plug in the anchor shell shall be checked with the manufacturer-supplied installation tool or other appropriate device. The position of the plug shall conform to the manufacturer's specifications.
 - 3. Allowable loads
 - a. Anchors not installed in underside of beam/slab:
 - 1. When tested in accordance with AC01, Section 5.6: Values listed in ICC-ES report
 - 2. When not tested in accordance with AC01, Section 5.6: 80% of values listed in ICC-ES report
 - b. Anchors installed in underside of beam/slab:
 - 1. When tested in accordance with AC01, Section 5.6: Values for anchor without special inspection or in cracked concrete in ICC-ES report
 - 2. When not tested in accordance with AC01, Section 5.6: 80% of values for anchor without special inspection or in cracked concrete in ICC-ES report
- C. Epoxy-type (adhesive) Anchors
 - 1. Allowable loads: values from ICC-ES report when compliant with AC58.
- D. Anchors must receive special inspection per CBC Section 1704.15.

3.5 TESTING AND INSPECTION OF POST-INSTALLED ANCHORS

- A. General
 - 1. Post-installed anchors shall be tested in accordance with the provisions of 2019 California Building Code Section 1901.3.4, by an authority having jurisdiction accepted testing facility, unless approval of an alternative individual is obtained in advance from the authority having jurisdiction.

2. If any anchor fails testing, test all anchors of the same type, not previously tested until twenty (20) consecutive anchors pass, then resume the initial test frequency. If the anchors are used for the support and bracing of non-structural components (pipe, duct or conduit), the twenty (20) shall be only those anchors installed by the same trade.
3. Test equipment (including torque wrenches) is to be calibrated by an approved testing laboratory in accordance with standard recognized procedures.
4. Regardless of which test method is chosen, test values and all appropriate criteria shall be shown on the contract documents.
5. Anchor diameter refers to the thread size for the wedge and sleeve categories, and to the anchor outside diameter for the sleeve category.
6. Apply proof test loads to wedge and sleeve anchors without removing the nut if possible. If not, remove nut and install a threaded coupler to the same tightness as the original nut using a torque wrench to apply the test load.
7. For sleeve/shell internally threaded categories, verify that the anchor is not prevented from withdrawing by a baseplate or other fixtures. If restraint is found, loosen and shim or remove fixture(s) prior to testing.
8. Reaction loads from test fixtures may be applied close to the anchor being tested, provided the anchor is not restrained from withdrawing by the fixture(s).
9. Alternate torque test procedures and test values for shell type anchors may be submitted to the enforcement agency for review and approval on a case-by-case basis when test procedures are submitted and approved by the enforcement agency.
10. Required test loads may be determined by either of the following methods:
 - a. Twice the allowable tension load from Part 3.4.
 - b. Tension or torque test values from the table and procedures.

Test Values (Hardrock or Lightweight Concrete)							
Anchor	Wedge		Sleeve		Shell		Screw
Diameter (in)	Load (lbs)	Torque (ft. lbs)	Load (lbs)	Torque (ft. lbs)	Load (lbs)	Torque (ft. lbs)	Torque (ft. lbs)
1/4	800	10	400	4	1000	-	-
5/16	-	-	400	5	1400	-	-
3/8	1100	25	700	10	1800	-	10
1/2	2000	50	900	20	2700	-	10
5/8	2300	80	1100	45	3700	-	10
3/4	3700	150	1400	90	5400	-	20
1	5800	250	-	-	-	-	-

11. If the manufacturer's recommended installation torque is less than the test torque noted in the table, the manufacturer's recommended installation torque should be used in lieu of the tabulated values.
- B. Expansion-type Anchors
1. The test load may be applied by any method that will effectively measure the tension in the anchor, such as direct pull with a hydraulic jack, calibrated spring loaded devices, or a calibrated torque wrench. Displacement-controlled anchors such as drop-ins shall not be tested using a torque wrench.
 2. Anchors tested with a hydraulic jack should exhibit no discernable movement during the tension test, e.g., as evidenced by loosening of the washer under the nut.
 3. Anchors tested with a calibrated torque wrench must attain the specified torque within 1/2 turn of the nut.
 4. Exceptions: Undercut anchors that are so designed to allow visual confirmation of full set, need not be tension or torque tested. If the manufacturer's installation

- torque is less than the specified test torque, use the manufacturer's specified installation torque for testing the anchor.
5. Apply proof test loads to wedge and sleeve anchors without removing the nut if possible. If not, remove nut and install a threaded coupler to the same tightness as the original nut using a torque wrench to apply the test load.
 6. For sleeve/shell internally threaded categories, verify that the anchor is not prevented from withdrawing by a baseplate or other fixtures. If restraint is found, loosen and shim or remove fixture(s) prior to testing.
 7. Reaction loads from test fixtures may be applied close to the anchor being tested, provided the anchor is not restrained from withdrawing by the fixture(s).
 8. Shell type anchors should be tested as follows:
 - a. Visually inspect 25% for full expansion as evidenced by the location of the expansion plug in the anchor body. Plug location of a fully expanded anchor should be as recommended by the manufacturer, or, in the absence of such recommendation, as determined on the job site following the manufacturer's installation instructions. At least 5% of the anchors shall be proof loaded as indicated in the table above, but not less than three anchors per day for each different person or crew installing anchors, or;
 - b. Test installed anchors per current edition of the CBC Section 1913A.7.
- C. Epoxy-type (adhesive) Anchors
1. Epoxy-type (adhesive) anchors shall be tension tested per current edition of the CBC Section 1913A.7. The tension test load shall equal twice the allowable load for the specific location of the anchor to be tested (i.e., accounting for edge distance) or 80% of the yield strength of the bolt ($0.8A_bF_y$), whichever is less. The test procedures for expansion-type anchors in the attached table shall also be used for epoxy-type (adhesive) anchors. Torque testing of epoxy-type (adhesive) anchors is not permitted.
 2. Where epoxy-type (adhesive) anchors are used as shear dowels across cold joints in slabs on grade and the slab is not part of the structural system, testing of those dowels is not required.
 3. Anchors shall exhibit no discernible movement during the tension test.
- D. Screw-type Anchors
- E. The following criteria apply for the acceptance of installed anchors:
1. Hydraulic ram method: The anchor should have no observable movement at the applicable test load. For wedge and sleeve type anchors, a practical way to determine observable movement is that the washer under the nut becomes loose.
 2. Torque wrench method: The applicable test torque must be reached within the following limits:
 - a. Wedge or Sleeve type: One-half (1/2) turn of the nut.
 - b. One-quarter (1/4) turn of the nut for the 3/8 in. sleeve anchor only.

3.6 PAINTING

- A. Touchup:
1. Clean field welds and abraded areas of shop paint.
 2. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting.
 3. Apply paint by brush or spray to provide minimum dry film thickness of 2.0 mils (0.05 mm).
 4. Comply with the following requirements
 - a. Architectural painting specifications
 - b. SSPC-PA 1 requirements for touching up field-painted surfaces.
- B. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A780.

END OF SECTION

PART 1 – GENERAL

1.1 SECTION INCLUDES

- A Testing in conformity with equipment applicable to this project, applicable codes and authorities having jurisdiction
- B Test equipment requirements listed in this section shall apply to testing required by all other sections in Division 26 specifications.

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A All included sections under Division 26
- B Plans
- C Manufacturers' manuals, product bulletins, etc.

1.3 REFERENCE STANDARDS AND CODES

- A Published specifications standards, tests or recommended methods of trade, industry or government organizations apply to work in this section as cited in Section 260000.
- B California Electrical Code
- C International Electrical Testing Association (NETA)
 - 1 NETA ATS: for Acceptance Testing Specifications for Electrical Power Equipment and Systems
- D Institute of Electrical and Electronic Engineers
 - 1 IEEE 81: Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System Part 1: Normal Measurements
 - 2 IEEE 82: Standard Test Procedure for Impulse Voltage Tests on Insulated Conductors
 - 3 IEEE 95: Standard Test Procedure for Impulse Voltage Tests on Insulated Conductors
 - 4 IEEE 112: Standard Test Procedure for Polyphase Induction Motors and Generators
 - 5 IEEE 114: Standard Test Procedure for Single-Phase Induction Motors
 - 6 IEEE 115: IEEE Guide for Test Procedures for Synchronous Machines Part I—Acceptance and Performance Testing Part II—Test Procedures and Parameter Determination for Dynamic Analysis
 - 7 IEEE 141: Recommended Practice for Electric Power Distribution for Industrial Plants
 - 8 IEEE 142: Recommended Practice for Grounding of Industrial and Commercial Power Systems
 - 9 IEEE 241: Recommended Practice for Electric Power Systems in Commercial Buildings
 - 10 IEEE 242: Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems (IEEE Buff Book)
 - 11 IEEE 252: Standard Test Procedure for Polyphase Induction Motors Having Liquid in the Magnetic Gap
 - 12 IEEE 259: Standard Test Procedure for Evaluation of Systems of Insulation for Dry-Type Specialty and General-Purpose Transformers
 - 13 IEEE 389: Recommended Practice for Testing Electronics Transformers and Inductors
 - 14 IEEE 393: Test Procedures for Magnetic Cores
 - 15 IEEE 399: Recommended Practice for Industrial and Commercial Power Systems Analysis (Brown Book)
 - 16 IEEE 400: Guide for Field Testing and Evaluation of the Insulation of Shielded Power Cable Systems Rated 5 kV and Above
 - 17 IEEE 442: Guide for Soil Thermal Resistivity Measurements

- 18 IEEE 495: Guide for Testing Faulted Circuit Indicators
- 19 IEEE 576: Recommended Practice for Installation, Termination, and Testing of Insulated Power Cable as Used in Industrial and Commercial Applications
- 20 IEEE 1188: Recommended Practice for Maintenance, Testing, and Replacement of Valve-Regulated Lead-Acid (VRLA) Batteries for Stationary Applications
- 21 IEEE 1234: Guide for Fault Locating Techniques on Shielded Power Cable Systems
- 22 IEEE 1415: Guide for Induction Machinery Maintenance Testing and Failure Analysis
- 23 IEEE 1458: Recommended Practice for the Selection, Field Testing, and Life Expectancy of Molded Case Circuit Breakers for Industrial Applications
- E National Institute of Standards and Technology (NIST)
- F Underwriters' Laboratories
 - 1 UL 1244: Electrical and Electronic Measuring and Testing Equipment
 - 2 UL 1436: Outlet Circuit Testers and Similar Indicating Devices
 - 3 UL 61010-2-030: Safety requirements for electrical equipment for measurement, control, and laboratory use - Part 2-030: Particular requirements for testing and measuring circuits
 - 4 UL 61010B-1: Electrical Measuring and Test Equipment – Part 1: General Requirements
 - 5 UL 61010B-2-031: Electrical Equipment for Measurement, Control, and Laboratory Use – Part 2: Particular Requirements for Hand-Held Probe Assemblies for Electrical Measurement and Test
 - 6 UL 61010B-2-032: Electrical Equipment for Measurement, Control, and Laboratory Use – Part 2: Particular Requirements for Hand-Held Current Clamps for Electrical Measurement and Test

1.4 QUALITY ASSURANCE

- A The Contractor shall engage and pay for the services of a recognized independent testing laboratory for the purpose of performing inspections and tests as herein specified.
- B The testing laboratory shall provide all material, equipment, labor and technical supervision to perform switch tests and inspections.
- C It is the intent of these tests to assure that all electrical equipment, both Contractor and Owner supplied, is operational within industry and manufacturer's tolerances and is installed in accordance with design specifications.
- D The tests and inspections shall determine the suitability for energizing.
- E Schedule tests and give a minimum of two weeks advance notice to the Owner.

1.5 SUBMITTALS

- A List of tests performed
- B Test procedures
- C Test results
- D The submittal shall be substantially complete for all items and equipment furnished under this section.
- E Individual drawings and data sheets submitted at random intervals will not be accepted for review.

1.6 QUALIFICATIONS OF TESTING AGENCY

The testing agency shall meet federal OSHA criteria for accreditation of testing laboratories, Standard Number 1910.7 (Definition and Requirements for a nationally recognized testing laboratory). International Electrical Testing Association (NETA) accreditation constitutes proof of meeting such criteria.

1.7 TEST INSTRUMENT TRACEABILITY

- A The testing laboratory shall have a calibration program which maintains all applicable test instrumentation within rated accuracy.
- B The accuracy shall be traceable to the National Institute of Standards and Technology (NIST) in an unbroken chain.
- C Instruments shall be calibrated in accordance with the following frequency schedule:
 - 1 Field instruments: 6 months maximum.
 - 2 Laboratory instruments: 12 months.
 - 3 Leased specialty equipment: 12 months
- D Dated calibration labels shall be visible on all test equipment.

1.8 FINAL SETTINGS

- A The test report shall include the following: summary of project, description of equipment tested, description of test, list of test equipment used in calibration and calibration date, test results, conclusions and recommendations, and appendix, including appropriate test forms.
- B The test report shall be bound and its contents certified.
- C Submit three copies of the completed report to the architect, or engineer if no architect is involved, no later than fifteen (15) days after completion of test, unless otherwise directed.

1.9 FAILURE TO TEST

- A Any system material or workmanship which is found defective on the basis of acceptance tests shall be reported directly to the architect or engineer if no architect is involved.
- B Contractor shall replace the defective material or equipment and have test repeated until test proves satisfactory without additional cost to the Owner.

PART 2 – PRODUCTS: [NOT USED]

PART 3 – EXECUTION

3.1 GROUND RESISTANCE TEST

- A Building ground electrode resistance testing shall be accomplished with a ground resistance, direct-reading, single test meter utilizing the Fall-of-Potential method and two (2) referenced electrodes. Perform test prior to interconnection to other grounding system. Orient the concrete-encased ground electrode to be tested and the two referenced electrodes in straight line spaces fifty (50) feet apart. Drive the two (2) reference electrodes ten (10) feet deep.
- B Test results shall be in writing, and shall show temperature, humidity and condition of the soil at the time of the tests. In the case where the ground resistance exceeds 25 ohms, add an additional ground rod and retest. Add additional ground rods when necessary in order to bring the ground resistance below 25 Ohms. All testing shall be done prior to concrete pour and in the presence of the inspector of record. Provide test results for engineer review.

3.2 MISCELLANEOUS TESTING

- A Functional and operational testing to the fire alarm, security system, telephone system, paging/intercom system, and all electrical components upon completion of electrical work.
- B Perform an insulation resistance test on all switchboard busses, bus ducts; feeder conductors, including neutrals, using a megohmmeter. Minimum value for each conductor shall be 20 megohms.

3.3 ELECTRICAL DISTRIBUTION EQUIPMENT OPERATIONAL CHECK

- A Electrical distribution equipment operational check includes main switchboards, distribution boards, panelboards, panels, switchgear, etc.
- B Verify proper operating condition of all equipment mechanically and electrically including, but not limited to verifying operation of each circuit breaker trip device with a rating of 100A or more using an accurately metered timed instrument (by passing 300% rated current through each pole).
- C If any equipment is found defective during operational check, it shall be replaced by the Contractor without cost to the Owner. The tests shall be repeated by the Contractor without cost to the owner until satisfactory results are obtained

3.4 CIRCUIT BREAKER ELECTRICAL COORDINATION STUDY

- A Contractor shall provide a coordination study to determine trip settings of circuit breakers so the new breakers being installed are selectively coordinated between the up and down stream breakers.

END OF SECTION

PART 1 – GENERAL

1.1 SECTION INCLUDES

Materials, equipment fabrication, installation and tests in conformity with applicable codes and authorities having jurisdiction, for the following:

- A Wiring devices
- B Terminal cabinets
- C Power distribution terminal blocks

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A All included sections under Division 26
- B Plans
- C Manufacturers' manuals, product bulletins, etc.

1.3 REFERENCE STANDARDS

Published specification standards, tests or recommended methods of trade, industry or government organizations apply to work in this section as cited in Section 260000.

- A California Building Code
- B California Electrical Code
- C Underwriters' Laboratories
 - 1 UL 20: General Use Snap Switches
 - 2 UL 50: Enclosures for Electrical Equipment, Non-environmental Considerations
 - 3 UL 50E: Enclosures for Electrical Equipment, Environmental Considerations
 - 4 UL 111: Multi-Outlet Assemblies
 - 5 UL 231: Power Outlets
 - 6 UL 486A: Wire Connectors
 - 7 UL 486B: Wire Connectors
 - 8 UL 486E: Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors
 - 9 UL 498: Attachment Plugs and Receptacles
 - 10 UL 514A: Metallic Outlet Boxes
 - 11 UL 514C: Nonmetallic Outlet Boxes, Flush-device Boxes, and Covers
 - 12 UL 514D: Cover Plates for Flush-mounted Wiring Devices
 - 13 UL 943: Ground Fault Circuit Interrupters
 - 14 UL 1681: Wiring Devices Configurations
 - 15 UL 1773: Standard for Termination Boxes
 - 16 UL 1953: Power Distribution Terminal Blocks
 - 17 UL 2255: Standard for Receptacle Closures
 - 18 UL 2682: Switch Rated Plugs and Receptacles

1.4 QUALITY ASSURANCE

- A Equipment and accessories shall be the product of a manufacturer regularly engaged in its manufacture.
- B Supply equipment and accessories new, free from defects.
- C Equipment and accessories in compliance with the applicable standards listed in Article 1.3 of this section and with applicable national, state and local codes.
- D Items of a given type shall be the products of the same manufacturer.
- E Deliver, store and protect products under provisions of Section 016200.
- F Ship equipment in its original packages, to prevent damaging or entrance of foreign matter. Perform handling and shipping in accordance with manufacturer's recommendations. Provide protective covering during construction.

- G Replace at no expense to Owner, equipment or material damaged during storage or handling, as directed by the engineer.
- H Tag items with a weatherproof tag identifying equipment by name and purchase order number. Include packing and shipping lists.

1.5 SUBMITTALS

- A Submit under provisions of Section 013000 or 013300.
- B Submittals shall include the following:
 - 1 Table of contents
 - 2 A complete set of detailed manufacturer's specifications describing and illustrating all standard and special components and materials
 - 3 Part numbers
 - 4 Evidence of compliance with the applicable standards listed under Article 1.3 of this section
 - 5 Maintenance instructions and intervals
 - 6 Calibration procedures and intervals
 - 7 A complete set of drawings for any special items
 - 8 A single line block diagram showing exactly the manner in which the contractor proposes to layout the system.
 - 9 Wiring diagrams
 - 10 Illustrations and scale drawing of the racks, equipment layouts etc.
 - 11 Drawings shall include designations, dimensions, operating controls, instruments, riser diagrams, routing diagrams etc.
 - 12 The contractor shall also submit a copy of his valid state contractor's license and show proof that he is a distributor of the submitted equipment.
- C Electronic submittals shall be searchable
- D The submittal shall be substantially complete for all items and equipment furnished under this section.
- E Individual drawings and data sheets submitted at random intervals will not be accepted for review.
- F Substitutions: Items of same function and performance shall be submitted in conformance with Division 1.

1.6 OPERATION AND MAINTENANCE MANUALS

- A Submit operation and maintenance manuals in accordance with Section 260000.
- B The manuals shall, at minimum, include the following:
 - 1 Manufacturer (including contact information)
 - 2 Model number
 - 3 Manufacturer's data sheets – When data sheets include more than one model the model(s) used shall be noted
 - 4 Manufacturer's user and maintenance manual(s), including trouble-shooting guidelines
 - 5 Configuration settings
 - 6 Wiring diagrams
 - 7 Voltage ratings
 - 8 Current ratings
 - 9 List of capabilities
 - 10 Environmental ratings
 - 11 NEMA enclosure type
 - 12 Maintenance requirements
 - 13 Installation instructions
 - 14 Repair instructions
- C Provide manuals in one of the following formats
 - 1 Three hardcopies

PART 2 – PRODUCTS

2.1 WIRING DEVICES

- A Wall (Local) Switches
 - 1 Totally enclosed
 - 2 AC rated
 - 3 20A rated
 - 4 Silent type, unless noted otherwise on the plans
 - 5 Manufacturers
 - a Hubbell Premise Wiring
 - b Leviton
 - 6 Industrial Grade or Extra Heavy Duty Specification Grade
- B Receptacles
 - 1 Duplex receptacles shall be 20A, 125V_{AC} rated, 3-wire, grounded
 - 2 Receptacle shall include a LED that indicates it has power.
 - 3 Receptacles shall be tamperproof.
 - 4 Manufacturers
 - a Hubbell Premise Wiring
 - b Leviton
 - 5 Industrial Grade or Extra Heavy Duty Specification Grade
 - 6 Exterior receptacle plates shall have steel, weatherproof, vandal-resistant while-in-use cover with key lockable/locking cover with keys to match owner standards.
 - 7 All automatically switched receptacles shall be marked per 2017 NEC 406.3(E).
- C Other special purpose receptacles shown on Drawings shall be of same quality.
- D GFI receptacles shall self test every 3 seconds and indicate if the GFI protection has passed or failed the test.
- E Wall Plates: Satin finish stainless steel
- F Switch and receptacle colors shall be as noted below unless otherwise specified.
 - 1 General purpose receptacles Gray
 - 2 Isolated Ground (IG) receptacle: Orange
 - 3 Equipment on emergency system: Red
 - 4 Receptacle with surge suppression: Blue
 - 5 Isolated ground receptacles with feature dependant color (other than orange) shall have orange triangle.
 - 6 Follow the facility has a color code scheme if the facility has one. Verify with owner.

2.2 TERMINAL CABINETS

- A Construction
 - 1 Fabricated from code gauge steel, size as indicated on drawings, with flush latch and concealed hinges and mounting screws.
 - 2 Enclosure for flush mounted cabinets shall be designed for flush mounting.
 - 3 Enclosure for surface mounted cabinets shall be designed for surface mounting.
- B Where size is not indicated, the minimum size shall be 24 inches wide x 30 inches high x 4 inches deep.
- C Cabinet shall be Square D “Mono-Flat Fronts”, or approved equal.
- D Terminal cabinets shall include a backboard at inside back of cabinet.
 - 1 The backboard shall be 3/4" inch thick plywood
 - 2 Paint backboard with 3 coats of fire retardant paint.
- E Provide and install one terminal point for each wire within the terminal cabinet.
- F NEMA type:
 - 1 Interior, non-corrosive, non-hazardous (classified) locations: NEMA 1

- 2 Exterior locations with vents: NEMA 3R
 - 3 Cooled enclosures: NEMA 4
 - 4 Enclosures containing electronics in dusty areas or outdoors: NEMA 4
 - 5 Enclosures in hazardous (classified) locations: NEMA 4 or 4X (corrosive locations) listed for hazardous classification
 - 6 Enclosure in corrosive locations: NEMA 4X
 - 7 All seams on NEMA 3R, 4, and 4X enclosures shall be continuously welded with welds ground smooth.
- G Coating
- 1 The completed enclosure shall be degreased and cleaned.
 - 2 After the cleaning process is finished, the enclosure shall be phosphatized.
 - 3 After the phosphatizing, the enclosure shall receive an electrostatic deposition of polyester powder coating followed by baking to produce a hard durable finish.
 - a The minimum thickness of the paint film shall be 2.0 mils.
 - b For the exterior of transformer tank, interior and exterior of primary and secondary cable compartments the minimum total dry film thickness shall be 3.5 mils.
 - c Paint film shall be uniform in color and free from blisters, sags, flaking and peeling
 - 4 Finish shall conform to UL 50 and UL 50E.
 - 5 Color shall be ANSI 61 Gray.
 - 6 Coat underside surfaces of equipment outdoors or in damp locations with a corrosion resistant coating.

2.3 POWER DISTRIBUTION TERMINAL BLOCKS

- A Power distribution terminal blocks (PDTB) shall be finger-safe, NEMA 1 type.
- B Conducting material shall be copper.
- C Current rating and short circuit rating of PDTBs shall be no lower than upstream overcurrent protective device.
- D Terminals
- 1 Each terminal shall be screw type and be designed for wire size connecting to it.
 - 2 PDTB shall have one terminal for each wire connected to it on both load and line sides.
- E Load wire sizes and OCPD shall comply with CEC 240.21(B) and 240.92(B) as well as all other applicable codes.
- F PDTBs shall have provisions for panel or DIN rail mounting.
- G PDTBs shall be mounted within enclosure unless otherwise noted.

2.4 NAMEPLATES

Provide and install nameplates per Section 260500.

PART 3 – EXECUTION

3.1 GENERAL

- A Electric system layouts indicated on the Drawings are generally diagrammatic, but shall be followed as closely as actual construction and work of other trades will permit. Govern exact routing of cable and wiring and the locations of outlets by the structure and equipment served. Dimensions shall be taken from Architectural Drawings.

- B Consult all other Drawings. Verify scales and report any dimensional discrepancies or other conflicts to architect, or engineer if no architect is involved, before submitting bid.
- C Home runs to panelboards are indicated as starting from the outlet nearest the panel and continuing in the general direction of that panel. Continue such circuits to the panel as though the routes were completely indicated. Terminate homeruns of signal, alarm, and communications system in a similar manner.
- D Avoid cutting and boring holes through structure or structural members wherever possible. Obtain prior approval of Architect and conform to structural requirements when cutting or boring the structure is necessary or permitted.
- E Furnish and install necessary hardware, hangers, blocking, brackets, bracing, runners, required for equipment specified under this section.
- F Provide necessary backing required to insure rigid mounting of outlet boxes.
- G Outlet boxes shall be plumb.
- H Back of wall plates shall be flush with wall finish. Gaps between wall plates and wall or wall plates not parallel to wall are not acceptable.

3.2 CONNECTIONS TO EQUIPMENT

- A General:
 - 1 Furnish and install required power supply conduit and wiring to equipment. See below for other wiring required.
 - 2 Install rough-in work for equipment from approved shop drawings to suit the specific requirements of the equipment.
 - 3 Furnish and install magnetic motor starters that are shown on the Drawings or specified under other divisions to be furnished under this division of work. Verify equipment nameplate ratings prior to installation and furnish adequately rated starters for the loads.
 - 4 Furnish and install manual thermal protection for motors not integrally equipped with thermal protection.
 - 5 Furnish and install 120V power to each control panel and time switch requiring a source of power to operate.
- B Heating, ventilating, and air conditioning equipment:
 - 1 Coordinate with mechanical contractor for sizes, locations and details of motors, heating units, and control requirements.
 - 2 Provide required power supply conduit and wiring to equipment.
 - 3 Provide a suitable means of disconnect switch immediately ahead of and adjacent to each motor and appliance unless the motor or appliance is located adjacent and within sight of the service panelboard, circuit breaker or switch at a distance allowed by codes. Verify equipment nameplate current ratings prior to installation. Provide a disconnect means at each magnetic motor starter.
 - 4 Provide magnetic motor starters required under this division of work.
 - 5 Provide manual thermal protection for motors not integrally equipped with thermal protection.
 - 6 Line and low voltage temperature control and interlock wiring, conduit, and required connections are a part of other divisions unless specifically shown or noted on the Drawings as to be furnished under this section.
 - 7 Provide 120V power supply to control panels, time switch furnished and installed under other divisions of work.
 - 8 Furnish and install 120V power to each duct detector scheduled for operation of fire dampers or shut down of mechanical equipment. Coordinate the exact quantity and locations with the mechanical drawings.
- C Plumbing and other contractor-furnished and Owner-furnished equipment:
 - 1 Required power and control conduit, wiring and connections are included under this section of the work. Control sensing and alarm devices will be furnished under the respective section of the contract supplying the equipment unless noted otherwise. These devices will be located in pipes, ducts, vessels, tanks, etc., and

will be mounted in a place by the Contractor furnishing the devices. Other devices shall be mounted under this section of the work.

- 2 Control panels for packaged equipment will be furnished under the respective section of the contract supplying the equipment unless otherwise noted. Installation and connection of the control panels are under this section of the work.

3.3 IDENTIFICATION

Refer to Section 260500.

END OF SECTION

PART 1 – GENERAL

1.1 SECTION INCLUDES

Materials, equipment fabrication, installation and tests in conformity with applicable codes and authorities having jurisdiction, for overcurrent protective devices

1.2 RELATED WORK SPECIFIED ELSEWHERE

- A All included sections under Division 26
- B Plans
- C Manufacturers' manuals, product bulletins, etc.

1.3 REFERENCE STANDARDS AND CODES

Published specification standards, tests or recommended methods of trade, industry or government organizations apply to work in this section as cited in Section 260000.

- A California Building Code
- B California Electrical Code
- C Institute of Electrical and Electronic Engineers
 - 1 IEEE 1015: Recommended Practice for Applying Low-Voltage Circuit Breakers Used in Industrial and Commercial Power Systems
 - 2 IEEE 1458: Recommended Practice for the Selection, Field Testing, and Life Expectancy of Molded Case Circuit Breakers for Industrial Applications
- D Underwriters' Laboratories
 - 1 UL 50: Enclosures for Electrical Equipment, Non-environmental Considerations
 - 2 UL 50E: Enclosures for Electrical Equipment, Environmental Considerations
 - 3 UL 98: Enclosed and Dead-front Switches
 - 4 UL 363: Knife Switches
 - 5 UL 489: Molded-case Circuit Breakers, Molded-case Switches, and Circuit Breaker Enclosures
 - 6 UL 1066: Standard for Low-Voltage AC and DC Power Circuit Breakers Used in Enclosures
 - 7 UL 2367: Standard for Solid State Overcurrent Protectors

1.4 QUALITY ASSURANCE

- A Equipment and accessories shall be the product of a manufacturer regularly engaged in its manufacture.
- B Supply equipment and accessories new, free from defects.
- C Equipment and accessories in compliance with the applicable standards listed in Article 1.3 of this section and with applicable national, state and local codes.
- D Items of a given type shall be the products of the same manufacturer.
- E Deliver, store and protect products under provisions of Section 016200.
- F Ship equipment in its original packages, to prevent damaging or entrance of foreign matter. Perform handling and shipping in accordance with manufacturer's recommendations. Provide protective covering during construction.
- G Replace at no expense to Owner, equipment or material damaged during storage or handling, as directed by the engineer.
- H Tag items with a weatherproof tag identifying equipment by name and purchase order number. Include packing and shipping lists.

1.5 SUBMITTALS

- A Submit under provisions of Section 013000 or 013300.
- B Submittals shall include the following:

- 1 Table of contents
 - 2 A complete set of detailed manufacturer's specifications describing and illustrating all standard and special components and materials
 - 3 Part numbers
 - 4 Evidence of compliance with the applicable standards listed under Article 1.3 of this section
 - 5 Maintenance instructions and intervals
 - 6 A complete set of drawings for any special items
 - 7 Wiring diagrams
- C Electronic submittals shall be searchable
- D The submittal shall be substantially complete for all items and equipment furnished under this section.
- E Individual drawings and data sheets submitted at random intervals will not be accepted for review.
- F Substitutions: Items of same function and performance shall be submitted in conformance with Division 1.

1.6 OPERATION AND MAINTENANCE MANUALS

- A Submit operation and maintenance manuals in accordance with Section 260000.
- B The manuals shall, at minimum, include the following:
- 1 Manufacturer (including contact information)
 - 2 Model number
 - 3 Manufacturer's data sheets – When data sheets include more than one model the model(s) used shall be noted
 - 4 Manufacturer's programming, user, and maintenance manual(s), including trouble-shooting guidelines
 - 5 Configuration settings
 - 6 Wiring diagrams
 - 7 Voltage ratings
 - 8 Current ratings
 - 9 Calibrated range
 - 10 List of capabilities
 - 11 Environmental ratings
 - 12 NEMA enclosure type
 - 13 Maintenance requirements
 - 14 Installation instructions
 - 15 Repair instructions
- C Provide manuals in one of the following formats
- 1 Three hardcopies
 - 2 PDF

PART 2 – PRODUCTS

2.1 CIRCUIT BREAKERS

- A Circuit breakers shall be constructed in accordance with the following standards:
- 1 UL 489 or UL 1066
 - 2 Federal Specification W-C-375B/GEN
 - 3 NEMA AB1
 - 4 CSA 22.2, No. 5-M91
 - 5 IEC 157-1
 - 6 BS 4752
- B Construction

- 1 Circuit breakers shall be constructed using glass reinforced polyester insulating material providing superior dielectric strength.
 - 2 Current-carrying components shall be completely isolated from the handle and the accessory mounting area.
 - 3 Breaker contact material shall be a non-weldable silver alloy.
 - 4 Breakers shall have arc-extinguishing chutes.
 - 5 Circuit breakers shall have an over-center, trip-free, toggle operating mechanism which will provide quick-make, quick-break contact action.
 - 6 Multiple pole breakers shall have a common trip element and a single operating handle.
 - 7 Circuit breakers for branch circuits shall be molded case
 - 8 Circuit breakers shall have bolt-on/plug-on type bus connectors.
- C Trip type
- 1 Circuit breakers having a frame size of 150 amperes or less shall have thermal magnetic non-interchangeable, trip-free sealed trip units.
 - 2 Circuit breakers with a frame size of 175 amperes up to 800 amperes shall have interchangeable thermal and adjustable magnetic trip elements with adjustable instantaneous, short-time, and long-time settings.
 - 3 Circuit breakers with a frame size of 800 amperes or greater shall have adjustable electronic trip units with adjustable instantaneous, short-time, and long-time settings.
- D There shall be two forms of visible trip indication.
- 1 The breaker handle shall reside in a position between ON and OFF.
 - 2 In addition, there shall be a red trip indicator appearing in the clear window of the circuit breaker housing.
- E Circuit breakers shall be UL Listed with amperage ratings, interrupting ratings, and number of poles as indicated on the panelboard schedules.
- F Circuit breaker faceplates shall be marked with the following
- 1 Rated ampacity
 - 2 UL and IEC certification standards
 - 3 Applicable voltage systems and corresponding AIR ratings
- G Lugs shall be UL Listed to accept solid or stranded copper and aluminum conductors. Lugs shall be suitable for 90°C rated wire, sized according to the 75°C temperature rating per CEC Table 310-16.
- H Branch circuit breakers rated 30 amperes and below shall be UL Listed to accept 60°C rated wire.
- I The interrupting capacity of all main and feeder branch circuit breakers shall be a minimum of 42,000A_{RMS} symmetrical amperes.
- J All circuit breakers feeding HVAC units, motors, or circuit breakers supplying loads other than convenience receptacles or lights shall have lockout devices.
- K Standard circuit breakers up to 250A at 600V_{AC} shall be UL Listed with HACR ratings.
- L All circuit breakers feeding 120V, 15A and 20A branch circuits in dwellings shall be AFCI.
- M Circuit breakers with shunt-trip or low voltage release shall be switch duty rated.
- N All fixed trip circuit breakers 1200A or greater and adjustable trip circuit breakers with a maximum rating 1200A or greater shall be equipped with one of the following methods to reduce arc flash energy.
- 1 Zone selective interlocking
 - 2 Differential relaying
 - 3 Arc flash detection and mitigation system in panel/board with the 1200A circuit breaker.

2.2 SAFETY SWITCHES (DISCONNECTS)

- A Switches shall be heavy duty type
- B Minimum voltage rating shall be 600V.
- C Minimum Size

- 1 Switches for disconnecting motors shall be sized for the horsepower of for motor(s).
 - 2 All switches shall be sized per the overcurrent protective device protecting the switch.
- D Construction
- 1 NEMA 1 for indoors
 - 2 NEMA 3R or NEMA 4 for outdoors
 - 3 Handle shall be lockable in the off/disconnected/open position.
- E The switch shall include a barrier between the fuse section and the switch section with separate doors for each section. The entire fuse section shall be de-energized when the switch is in the off position.
- F Switch shall be equivalent to Square D H-rated series.
- G Finish: The entire enclosure shall be finished as follows.
- 1 Degreasing
 - 2 Cleaning
 - 3 Phosphatizing
 - 4 Electrostatic deposition of polymer polyester powder coating followed by baking to produce a hard, durable finish.
 - a The minimum thickness of the paint film shall be 2.0 mils.
 - b Paint film shall be uniform in color and free from blisters, sags, flaking and peeling
 - 5 Finish shall conform to UL 50 and UL 50E.
 - 6 Color shall be ANSI 61 Gray.
 - 7 Coat underside surfaces of equipment outdoors or in damp locations with a corrosion resistant coating

PART 3 – EXECUTION

3.1 GENERAL

- A Electric system layouts indicated on the Drawings are generally diagrammatic but shall be followed as closely as actual construction and work of other trades will permit. Govern exact routing of cable and wiring and the locations of outlets by the structure and equipment served. Dimensions shall be taken from Architectural Drawings.
- B Consult all other Drawings. Verify scales and report any dimensional discrepancies or other conflicts to architect, or engineer if no architect is involved, before submitting bid.
- C Furnish and install necessary hardware, hangers, blocking, brackets, bracing, runners, required for equipment specified under this section.

3.2 OVER CURRENT PROTECTION DEVICE COORDINATION STUDY

- A Contractor shall have a third party provide a coordination study to determine trip settings of circuit breakers and/or appropriate fuse types.
- B Fault, circuit overload, etc shall only trip closest circuit breaker or melt closest fuse. No other circuits shall be affected.

END OF SECTION